







City of Rochester  
FIRE DEPARTMENT

FIRE SAFETY DIVISION

185 Exchange Blvd., Suite 665  
Rochester, New York 14614  
(585) 428-7037

DATE 06/20/12

PERMIT

For keeping, storing, using, installing, manufacturing, handling, transporting, or otherwise employing flammable, combustible, or explosive materials, or materials, processes, or equipment, which if improperly used may produce conditions hazardous to life or property.

TO WHOM IT MAY CONCERN:

By virtue of the provisions of the Fire Prevention Code of the City of Rochester, NY.,

UNITED RENTALS  
788 RIDGE

RD W

13-06115	PERMIT NUMBER
----------	---------------

having made application in due form, and as the conditions, surroundings, and arrangements are, in my opinion, such that the intent of the Fire Prevention Code can be observed, authority is hereby given and this PERMIT is GRANTED for:

PERMIT CODE	PERMIT CATEGORY	FEE
5412B10C1	FLAM/COMB LQD CLS I,II,III	\$ 70
5412B21A	LPG 1000 GAL OR MORE	\$ 100
5412B18	ACETYLENE/FLAMMABLE GAS USAGE	\$ 70
5412B23A	PRIVATE PLANT	\$ 70
5412B23B	PRIVATE PLANT DISPENSING UNITS	\$ 40
<b>TOTAL</b>		<b>\$ 350</b>

This PERMIT is issued and accepted on condition that all Fire Prevention Code provisions now adopted, or that may hereafter be adopted, shall be complied with, and said PERMIT will become valid only after receipt of total fee payment.

THIS PERMIT EXPIRES 06/30/13

This permit does not take the place of any License required by law and is not transferable. Any change in the use or occupancy of premises shall require a new permit.

*Signature of Fire Marshal*  
FIRE MARSHAL

THIS PERMIT MUST AT ALL TIMES BE KEPT ON FILE AT THE PREMISES MENTIONED ABOVE

**Please return this part with payment**

MAKE YOUR CHECK OR MONEY ORDER, PAID IN FULL,  
PAYABLE TO CITY TREASURER AND MAIL TO:

PLEASE WRITE PERMIT NUMBERS

ON YOUR CHECK OR MONEY ORDER

ROCHESTER FIRE DEPARTMENT  
ATTENTION: ACCOUNTS RECEIVABLE  
185 EXCHANGE BLVD., SUITE 663  
ROCHESTER, NEW YORK 14614

00788 RIDGE RD W

13-06115	PERMIT NUMBER
06/20/12	INVOICE DATE
07/20/12	DUE DATE
\$ 350	AMOUNT DUE

UR SHARED SERV CTR ACCOUNTS PAY  
UNITED RENTALS  
788 W RIDGE RD  
ROCHESTER NY 14615

*Handwritten initials and date 7/9/12*

**Permit fee payments not received by the due date will be considered delinquent.**

**These delinquent properties operating with invalid permits will be subject to the issuance of a Municipal Code Violations Summons pursuant to Chapter 54-10 of the Municipal Code.**

**Municipal Code Summons Schedule**

	<b>Initial</b>	<b>Default</b>
<b>1st Offense, or after 30 days</b>	<b>\$ 75.00</b>	<b>\$150.00</b>
<b>2nd Offense, or after 60 days</b>	<b>\$150.00</b>	<b>\$300.00</b>
<b>3rd Offense, or after 90 days</b>	<b>\$375.00</b>	<b>\$750.00</b>



# City of Rochester FIRE DEPARTMENT

FIRE SAFETY DIVISION

185 Exchange Blvd., Suite 665  
Rochester, New York 14614  
(585) 428-7037

## PERMIT

DATE 07/05/11

For keeping, storing, using, installing, manufacturing, handling, transporting, or otherwise employing flammable, combustible, or explosive materials, or materials, processes, or equipment, which if improperly used may produce conditions hazardous to life or property.

TO WHOM IT MAY CONCERN:

By virtue of the provisions of the Fire Prevention Code of the City of Rochester, NY.,

UNITED RENTALS  
788 RIDGE

RD W

12-06117	PERMIT NUMBER
----------	---------------

having made application in due form, and as the conditions, surroundings, and arrangements are, in my opinion, such that the intent of the Fire Prevention Code can be observed, authority is hereby given and this PERMIT is GRANTED for:

PERMIT CATEGORY	FEE
-----------------	-----

**Please return this part with payment**

MAKE YOUR CHECK OR MONEY ORDER, PAID IN FULL,  
PAYABLE TO CITY TREASURER AND MAIL TO:

PLEASE WRITE PERMIT NUMBERS

ON YOUR CHECK OR MONEY ORDER

ROCHESTER FIRE DEPARTMENT  
ATTENTION: ACCOUNTS RECEIVABLE  
185 EXCHANGE BLVD., SUITE 663  
ROCHESTER, NEW YORK 14614

00788 RIDGE

RD W

12-06117	PERMIT NUMBER
07/05/11	INVOICE DATE
08/05/11	DUE DATE
\$ 350	AMOUNT DUE

UR SHARED SERV CTR ACCOUNTS PAY  
UNITED RENTALS  
788 W RIDGE RD  
ROCHESTER NY 14615

*pd 4/27/12*  
*JA*

FD513

fdpmt1

This PERMIT is issued and accepted on condition that all Fire Prevention Code provisions now adopted, or that may hereafter be adopted, shall be complied with, and said PERMIT will become valid only after receipt of total fee payment.

THIS PERMIT EXPIRES

06/30/12

This permit does not take the place of any License required by law and is not transferable. Any change in the use or occupancy of premises shall require a new permit.

*Signature of Fire Marshal*  
FIRE MARSHAL

THIS PERMIT MUST AT ALL TIMES BE KEPT ON FILE AT THE PREMISES MENTIONED ABOVE

**Please return this part with payment**

MAKE YOUR CHECK OR MONEY ORDER, PAID IN FULL,  
PAYABLE TO CITY TREASURER AND MAIL TO:

PLEASE WRITE PERMIT NUMBERS

ON YOUR CHECK OR MONEY ORDER

ROCHESTER FIRE DEPARTMENT  
ATTENTION: ACCOUNTS RECEIVABLE  
185 EXCHANGE BLVD., SUITE 663  
ROCHESTER, NEW YORK 14614

00788 RIDGE

RD W

12-06117	PERMIT NUMBER
07/05/11	INVOICE DATE
08/05/11	DUE DATE
\$ 350	AMOUNT DUE

UR SHARED SERV CTR ACCOUNTS PAY  
UNITED RENTALS  
788 W RIDGE RD  
ROCHESTER NY 14615

FD513

fdpmt1

Permit fee payments not received by the due date will be considered delinquent.

These delinquent properties operating with invalid permits will be subject to the issuance of a Municipal Code Violations Summons pursuant to Chapter 54-10 of the Municipal Code.

Municipal Code Summons Schedule

	Initial	Default
1st Offense, or after 30 days	\$ 75.00	\$150.00
2nd Offense, or after 60 days	\$150.00	\$300.00
3rd Offense, or after 90 days	\$375.00	\$750.00







# City of Rochester FIRE DEPARTMENT

FIRE SAFETY DIVISION

185 Exchange Blvd., Suite 665  
Rochester, New York 14614  
(585) 428-7037

## PERMIT

DATE 06/10/10

For keeping, storing, using, installing, manufacturing, handling, transporting, or otherwise employing flammable, combustible, or explosive materials, or materials, processes, or equipment, which if improperly used may produce conditions hazardous to life or property.

TO WHOM IT MAY CONCERN:

By virtue of the provisions of the Fire Prevention Code of the City of Rochester, NY.,

UNITED RENTALS  
788 RIDGE

RD W

11-06113	PERMIT NUMBER
----------	---------------

having made application in due form, and as the conditions, surroundings, and arrangements are, in my opinion, such that the intent of the Fire Prevention Code can be observed, authority is hereby given and this PERMIT is GRANTED for:

PERMIT CODE	PERMIT CATEGORY	FEE
5412B10C1	FLAM/COMR JOD CIS I L L W	

**Please return this part with payment**

MAKE YOUR CHECK OR MONEY ORDER, PAID IN FULL,  
PAYABLE TO CITY TREASURER AND MAIL TO:

ROCHESTER FIRE DEPARTMENT  
ATTENTION: ACCOUNTS RECEIVABLE  
185 EXCHANGE BLVD., SUITE 663  
ROCHESTER, NEW YORK 14614

UR SHARED SERV CTR ACCOUNTS PAY  
UNITED RENTALS  
788 W RIDGE RD  
ROCHESTER NY 14615

PLEASE WRITE PERMIT NUMBERS  
ON YOUR CHECK OR MONEY ORDER  
00788 RIDGE RD W

11-06113	PERMIT NUMBER
06/10/10	INVOICE DATE
07/10/10	DUE DATE
\$ 350	AMOUNT DUE

**PAID**  
*[Signature]*

*Cont. #4723701*

FD513

fdpmt1

shall be complied with, and said PERMIT will become valid only after receipt of total fee payment.

THIS PERMIT EXPIRES **06/30/11**

This permit does not take the place of any License required by law and is not transferable. Any change in the use or occupancy of premises shall require a new permit.

*[Signature]*  
FIRE MARSHAL

THIS PERMIT MUST AT ALL TIMES BE KEPT ON FILE AT THE PREMISES MENTIONED ABOVE

**Please return this part with payment**

MAKE YOUR CHECK OR MONEY ORDER, PAID IN FULL,  
PAYABLE TO CITY TREASURER AND MAIL TO:

ROCHESTER FIRE DEPARTMENT  
ATTENTION: ACCOUNTS RECEIVABLE  
185 EXCHANGE BLVD., SUITE 663  
ROCHESTER, NEW YORK 14614

UR SHARED SERV CTR ACCOUNTS PAY  
UNITED RENTALS  
788 W RIDGE RD  
ROCHESTER NY 14615

PLEASE WRITE PERMIT NUMBERS  
ON YOUR CHECK OR MONEY ORDER  
00788 RIDGE RD W

11-06113	PERMIT NUMBER
06/10/10	INVOICE DATE
07/10/10	DUE DATE
\$ 350	AMOUNT DUE

FD513

fdpmt1

Permit fee payments not received by the due date will be considered delinquent.

These delinquent properties operating with invalid permits will be subject to the issuance of a Municipal Code Violations Summons pursuant to Chapter 54-10 of the Municipal Code.

Municipal Code Summons Schedule

	<b>Initial</b>	<b>Default</b>
<b>1st Offense, or after 30 days</b>	<b>\$ 75.00</b>	<b>\$150.00</b>
<b>2nd Offense, or after 60 days</b>	<b>\$150.00</b>	<b>\$300.00</b>
<b>3rd Offense, or after 90 days</b>	<b>\$375.00</b>	<b>\$750.00</b>

---



# City of Rochester

Fire Department  
185 Exchange Boulevard, Suite 665  
Rochester, New York 14614-2124  
www.cityofrochester.gov



Fire Safety  
Division

July 26, 2010

United Rentals  
UR Shared Serv Ctr Accounts Payable  
788 W Ridge Rd.  
Rochester, NY 14615

To Whom It May Concern:

This letter is to inform you that your Fire Safety Permit for the business located at 788 W Ridge Rd. is delinquent for nonpayment. The amount of the permit is \$350.00. This is a final notice for the permit #11-06113.

**We must receive your payment of \$ 350.00 within 5 business days from the date of this letter.** If you do not comply with this request for payment, a Summons for a violation of the Municipal Code will be issued.

The fee for a summons violation is as follows:

First Offense	\$ 75.00
Second Offense	\$ 150.00
Third Offense	\$ 375.00

Please remit your payment payable to the City Treasurer and mail it to the following address immediately:

Rochester Fire Department  
Attention: Accounts Receivable  
185 Exchange Blvd. Suite 663  
Rochester, NY 14614

Your anticipated compliance to this notice is appreciated.  
If you have any questions, please contact Connie Mendola at (585) 428-3693.

Sincerely,

Tom Szatko, Captain  
Supervising Code Enforcement Officer

TS:cm  
Enclosure: Copy of Permit Statement





# City of Rochester FIRE DEPARTMENT

FIRE SAFETY DIVISION

185 Exchange Blvd., Suite 665  
Rochester, New York 14614  
(585) 428-7037

DATE 06/06/08

## PERMIT

For keeping, storing, using, installing, manufacturing, handling, transporting, or otherwise employing flammable, combustible, or explosive materials, or materials, processes, or equipment, which if improperly used may produce conditions hazardous to life or property.

TO WHOM IT MAY CONCERN:

By virtue of the provisions of the Fire Prevention Code of the City of Rochester, NY.,

UNITED RENTALS  
788 RIDGE

RD W

09-06120	PERMIT NUMBER
----------	---------------

having made application in due form, and as the conditions, surroundings, and arrangements are, in my opinion, such that the intent of the Fire Prevention Code can be observed, authority is hereby given and this PERMIT is GRANTED for:

PERMIT CODE	PERMIT CATEGORY	FEE
-------------	-----------------	-----

**Please return this part with payment**

MAKE YOUR CHECK OR MONEY ORDER, PAID IN FULL,  
PAYABLE TO CITY TREASURER AND MAIL TO:

PLEASE WRITE PERMIT NUMBERS

ON YOUR CHECK OR MONEY ORDER

ROC 5412, 788 W RIDGE RD  
ATTENTION: ACCOUNTS RECEIVABLE  
185 EXCHANGE BLVD., SUITE 663  
ROCHESTER, NEW YORK 14614

00788 RIDGE

RD W

09-06120	PERMIT NUMBER
06/06/08	INVOICE DATE
07/06/08	DUE DATE
\$ 350	AMOUNT DUE

AUG 5 2008

UNITED RENTALS  
788 W RIDGE RD  
ROCHESTER MY 14615

FD513

fdpmt1

This permit is issued and accepted on condition that all Fire Prevention Code provisions now adopted, or that may hereafter be adopted, shall be complied with, and said PERMIT will become valid only after receipt of total fee payment.

THIS PERMIT EXPIRES

06/30/09

This permit does not take the place of any License required by law and is not transferable. Any change in the use or occupancy of premises shall require a new permit.

FIRE MARSHAL

THIS PERMIT MUST AT ALL TIMES BE KEPT ON FILE AT THE PREMISES MENTIONED ABOVE

**Please return this part with payment**

MAKE YOUR CHECK OR MONEY ORDER, PAID IN FULL,  
PAYABLE TO CITY TREASURER AND MAIL TO:

PLEASE WRITE PERMIT NUMBERS

ON YOUR CHECK OR MONEY ORDER

ROCHESTER FIRE DEPARTMENT  
ATTENTION: ACCOUNTS RECEIVABLE  
185 EXCHANGE BLVD., SUITE 663  
ROCHESTER, NEW YORK 14614

00788 RIDGE

RD W

09-06120	PERMIT NUMBER
06/06/08	INVOICE DATE
07/06/08	DUE DATE
\$ 350	AMOUNT DUE

UNITED RENTALS  
788 W RIDGE RD  
ROCHESTER MY 14615

FD513

fdpmt1

Permit fee payments not received by the due date will be considered delinquent.

These delinquent properties operating with invalid permits will be subject to the issuance of a Municipal Code Violations Summons pursuant to Chapter 54-10 of the Municipal Code.

Municipal Code Summons Schedule

	Initial	Default
1st Offense, or after 30 days	\$ 75.00	\$150.00
2nd Offense, or after 60 days	\$150.00	\$300.00
3rd Offense, or after 90 days	\$375.00	\$750.00



# City of Rochester FIRE DEPARTMENT

FIRE SAFETY DIVISION

185 Exchange Blvd., Suite 665  
Rochester, New York 14614  
(585) 428-7037

## PERMIT

DATE 06/06/07

For keeping, storing, using, installing, manufacturing, handling, transporting, or otherwise employing flammable, combustible, or explosive materials, or materials, processes, or equipment, which if improperly used may produce conditions hazardous to life or property.

**TO WHOM IT MAY CONCERN:**

By virtue of the provisions of the Fire Prevention Code of the City of Rochester, NY,

**UNITED RENTALS**  
788 RIDGE

RD W

08-06118	PERMIT NUMBER
----------	---------------

having made application in due form, and as the conditions, surroundings, and arrangements are, in my opinion, such that the intent of the Fire Prevention Code can be observed, authority is hereby given and this PERMIT is GRANTED for:

**Please return this part with payment**

MAKE YOUR CHECK OR MONEY ORDER, PAID IN FULL,  
PAYABLE TO CITY TREASURER AND MAIL TO:

PLEASE WRITE PERMIT NUMBERS

ON YOUR CHECK OR MONEY ORDER

ROCHESTER FIRE DEPARTMENT  
ATTENTION: ACCOUNTS RECEIVABLE  
185 EXCHANGE BLVD., SUITE 663  
ROCHESTER, NEW YORK 14614

00788 RIDGE

RD W

08-06118	PERMIT NUMBER
06/06/07	INVOICE DATE
07/06/07	DUE DATE
\$ 350	AMOUNT DUE

UNITED RENTALS  
788 W RIDGE RD  
ROCHESTER MY 14615

JUL 26 2007

*ed*

FD513

fdpmt1

TOTAL \$ 350

This PERMIT is issued and accepted on condition that all Fire Prevention Code provisions now adopted, or that may hereafter be adopted, shall be complied with, and said PERMIT will become valid only after receipt of total fee payment.

THIS PERMIT EXPIRES

06/30/08

This permit does not take the place of any License required by law and is not transferable. Any change in the use or occupancy of premises shall require a new permit.

*Joseph W. Kelly*  
FIRE MARSHAL

THIS PERMIT MUST AT ALL TIMES BE KEPT ON FILE AT THE PREMISES MENTIONED ABOVE

**Please return this part with payment**

MAKE YOUR CHECK OR MONEY ORDER, PAID IN FULL,  
PAYABLE TO CITY TREASURER AND MAIL TO:

PLEASE WRITE PERMIT NUMBERS

ON YOUR CHECK OR MONEY ORDER

ROCHESTER FIRE DEPARTMENT  
ATTENTION: ACCOUNTS RECEIVABLE  
185 EXCHANGE BLVD., SUITE 663  
ROCHESTER, NEW YORK 14614

00788 RIDGE

RD W

08-06118	PERMIT NUMBER
06/06/07	INVOICE DATE
07/06/07	DUE DATE
\$ 350	AMOUNT DUE

UNITED RENTALS  
788 W RIDGE RD  
ROCHESTER MY 14615

FD513

fdpmt1

Permit fee payments not received by the due date will be considered delinquent.

These delinquent properties operating with invalid permits will be subject to the issuance of a Municipal Code Violations Summons pursuant to Chapter 54-10 of the Municipal Code.

Municipal Code Summons Schedule

	<b>Initial</b>	<b>Default</b>
<b>1st Offense, or after 30 days</b>	<b>\$ 75.00</b>	<b>\$150.00</b>
<b>2nd Offense, or after 60 days</b>	<b>\$150.00</b>	<b>\$300.00</b>
<b>3rd Offense, or after 90 days</b>	<b>\$375.00</b>	<b>\$750.00</b>

# SOLUTIC NET INC.

24-HOUR SERVICES 585-521-5837

## Fire Protection Systems Inspection & Test Report

COMPANY <i>United Rentals</i>			DATE <i>5/14/07</i>				
ADDRESS <i>788 W. Ridge Rd</i>			CONTROL PANEL TYPE <i>FCI</i>				
CITY <i>Greece</i>		STATE <i>NY</i>		ZIP <i>14615</i>		SYSTEM LOCATION <i>Telephone Room (Auto Dept)</i>	
<u>Installation / Inspection</u>		Installation	<u>Annual</u>	Semi-Annual	Quarterly	Monthly	Other
Equipment		# of Devices	# Tested	Comments:			
Control Panels		<i>1</i>	<i>1</i>	<i>* All devices tested were operational</i>			
Annunciators		<i>1</i>	<i>1</i>				
Heat Detectors		<i>8</i>	<i>8</i>				
Smoke Detectors		<i>3</i>	<i>3</i>				
Pull Stations		<i>5</i>	<i>5</i>				
Signal Devices		<i>5</i>	<i>5</i>	<i>* Customer requests not to sound bells</i>			
Fan Shutdown							
Fire Suppressant							
Door Holders							
Trouble Devices							
Remote Stations							
Dampers							
Batteries		<i>2</i>	<i>2</i>	<i>13.0 VDC - 13.1 VDC</i>			
Charger		<i>1</i>	<i>1</i>				
Abort Stations							
EOP Shutdown							
Duct Detectors							
Beam Detectors							
Elevator Recall							
Roof Hatches							
Tamper Switches							
Flow Switches							
<u>Monitored/Local Alarm</u>				<i>* Monitored by West Fire</i>			
Local Fire Dept. <i>Rochester</i>		Official Contacted <i>West Fire</i>		Test Received <u>Yes/No</u>	Test Completed <i>2:00</i>	AM/PM <u>(PM)</u>	

### Limitations of Liability

The Contractor makes NO WARRANTIES, EXPRESS, OR IMPLIED, INCLUDING, WITHOUT LIMITATION, WARRANTIES OF MERCHANTABILITY AND WARRANTIES OF FITNESS FOR A PARTICULAR PURPOSE. No promise not contained herein or affirmation of fact made by an employee, agent, or representative of the contractor shall constitute a warranty by the seller or give rise to any liability or obligation.

Contractor's liability to Subscriber for personal injury, death, or property damage arising from performance under this contract shall be limited to the contract price. Subscriber shall hold Contractor harmless from any and all third party claims, for personal injury, death, or property damage arising from the subscriber's failure to maintain these systems or keep them in operative condition, whether based upon contract, warranty, tort, strict liability, or otherwise. In no event shall the contractor be liable for any special, indirect, incidental, consequential, or liquidated penal or any economic loss damages of any character, including but not limited to loss of the use of the subscriber's property, lost profits, or loss production, whether claimed by the subscriber or by any third party, irrespective of whether claims or actions for such damages are based upon contract, warranty, negligence, tort, strict liability, or otherwise.

*R. W. [Signature]*  
Customer Signature

*[Signature]*  
Technician Signature

# SC L JTIC NET INC.

24-HOUR SERVICES 585-521-5837

## Fire Protection Systems Inspection & Test Report

COMPANY <i>United Rentals</i>			DATE <i>5 / 16 / 06</i>				
ADDRESS <i>789 W. Ridge Rd.</i>			CONTROL PANEL TYPE <i>FCI</i>				
CITY <i>Rochester</i>	STATE <i>NY</i>	ZIP <i>14615</i>	SYSTEM LOCATION <i>Telephone Room (Auto Depot)</i>				
<b>Installation / Inspection</b>		<b>Installation</b>	<b>Annual</b>	<b>Semi-Annual</b>	<b>Quarterly</b>	<b>Monthly</b>	<b>Other</b>
<b>Equipment</b>		<b># of Devices</b>	<b># Tested</b>	<b>Comments:</b>			
Control Panels		<i>1</i>	<i>1</i>				
Annunciators		<i>1</i>	<i>1</i>				
Heat Detectors		<i>8</i>	<i>8</i>				
Smoke Detectors		<i>3</i>	<i>3</i>				
Pull Stations		<i>5</i>	<i>5</i>				
Signal Devices		<i>5</i>	<i>5</i>				
Fan Shutdown							
Fire Suppressant							
Door Holders							
Trouble Devices							
Remote Stations							
Dampers							
Batteries		<i>2</i>	<i>2</i>	<i>13.1 vdc - 13.2 vdc</i>			
Charger		<i>1</i>	<i>1</i>				
Abort Stations							
EOP Shutdown							
<b>Monitored / Local Alarm</b>				<i>* Monitored by West Fire</i>			
Local Fire Dept. <i>Rochester</i>		Official Contacted <i>West Fire</i>		Test Received <b>Yes / No</b>	Test Completed <i>2:30</i>		AM / PM <b>PM</b>

**Limitation of Liability**

The Contractor makes NO WARRANTIES, EXPRESS, OR IMPLIED, INCLUDING, WITHOUT LIMITATION, WARRANTIES OF MECHANABILITY AND WARRANTIES OF FITNESS FOR A PARTICULAR PURPOSE. No promise not contained herein or affirmation of fact made by an employee, agent, or representative of the contractor shall constitute a warranty by the seller or give rise to any liability or obligation.

Contractor's liability to Subscriber for personal injury, death, or property damage arising from performance under this contract shall be limited to the contract price. Subscriber shall hold Contractor harmless from any and all third party claims, for personal injury, death, or property damage arising from the subscriber's failure to maintain these systems or keep them in operative condition, whether based upon contract, warranty, tort, strict liability, or otherwise. In no event shall the contractor be liable for any special, indirect, incidental, consequential, or liquidated penal or any economic loss damages of any character, including but not limited to loss of the use of the subscriber's property, lost profits, or loss production, whether claimed by the subscriber or by any third party, irrespective of whether claims or actions for such damages are based upon contract, warranty, negligence, tort, strict liability, or otherwise.

*R. Ungert*  
Customer Signature

*Blf. Papi*  
Technician Signature

# FIRE-ENGINEERED BY CHEMICAL SYSTEM REPORT

AM

Date of service: 1-04-07 Time: 11:00 PM

Annual  Semi-Annual  Recharge  Installation  Renovation

<input type="checkbox"/> Amerex	<input type="checkbox"/> Ansul	<input type="checkbox"/> Badger	<input checked="" type="checkbox"/> Kidde
<input type="checkbox"/> Pem-All	<input type="checkbox"/> Pyro-Chem	<input type="checkbox"/> Other	

### Customer/Location

Name: United Rentals  
 Address: 738 West Lodge Rd.  
 City/ST/Zip: Rochester Ny 14615  
 Phone: 621-7313  
 Owner or Manager: Ronnie

Total flooding system  Local application system

Single  Double  Triple  Other

Model # and type: IND 50 + IND 20

Connected reserve

Location of system: BETWEEN TANKS

Area protected: BOTH 150 GALLON TANKS

	Yes	No	N/A
1 System interlocked with building fire alarm	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
2 System discharged	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
3 All seals intact. No evidence of tampering	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
4 Hazard properly covered w/correct nozzles	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
5 Checked positioning of all nozzles	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
6 Pressure gauge in proper range	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
7 Checked cartridge weight Last Test Repl	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
8 Checked Pneumatic actuator	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
9 Cylinder hydrostatic Test Date <u>2-6-05</u> 6 Year Maint. <u>00-1-5</u>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
10 Inspect cylinder and mount	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
11 Operated system from terminal link	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
12 Checked operation of electric detection	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
13 Checked travel of cable and link position	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
14 Fusible links, quantity of each			
135° _____ 165° _____ 212° _____ 280° _____			
360° _____ 450° _____ 500° _____ other _____			
15 Thermal detectors, quantity of each			
225° <u>7</u> 325° _____ 450° _____ 600° _____			
16 Replaced fusible links Mfg. date	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
17 Checked and cleaned fusible links	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>

	Yes	No	N/A
18 Checked operation of manual release	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
19 Checked operation of time delay	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
20 Checked operation of micro-switch	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
21 Checked operation of gas valve. Size: _____			
<input type="checkbox"/> Mechanical <input checked="" type="checkbox"/> Electrical	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
22 Checked operation of shut downs	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
23 Checked reserve power supply	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
24 Piping/conduit securely bracketed	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
25 Nozzles cleaned and proper caps/covers in place	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
26 System cartridge & seals replaced/safety pins removed	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
27 System operational and armed	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
28 Proper fire extinguisher for other areas	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
29 Fire extinguishers properly serviced	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
30 Personnel instructed on automatic operation of system	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
31 Personnel instructed on manual operational of system	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
32 Were system monthly inspections performed?	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
33 Was fire extinguisher training provided?	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
34 Service and certification tag on system	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
35 System installed per current UL 1254 standard and meets manufacturer's UL listing	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
36 Plans of original system installation on site	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>

NO BUT STILL APPROVED

Note: Non-compliant systems might fail to extinguish/suppress a fire.

COMMENTS/NON-COMPLIANCE System is not alarmed, all tanks fully charged.

Ronnie 1-4-07 11:00  
 Technician Date Time

x [Signature]  
 Customer's Authorized Agent

Monthly Inspection of Emergency Lights - 2006

- 1 - Above window in showroom
- 1 Emergency light in hallway to back
- 1 Emergency light above door to back
- 1 Above Blue door in shop area

Please insert actual date inspected & check off each light in column

Date Inspected	Hallway Light	Light Above Door to Shop	Window Showroom	Blue Door to Exit Shop
Jan-06	1/0	1/0	1/0	1/0
Notes	0	0	0	0
Feb '06	2/7	2/7	2/7	2/7
Notes	0	0	0	0
March '06	3/8	3/8	3/8	3/8
Notes	0	0	0	0
April '06	4/5	4/5	4/5	4/5
Notes	0	0	0	0
May '06	5/8	5/8	5/8	5/8
Notes	0	0	0	0
June '06	6/2	6/2	6/2	6/2
Notes	0	0	0	0
July '06	7/7	7/7	7/7	7/7
Notes	0	0	0	0
August '06	8/9	8/9	8/9	8/9
Notes	0	0	0	0
Sept '06	9/6	9/6	9/6	9/6
Notes	0	0	0	0
Oct '06	10/4	10/4	10/4	10/4
Notes	0	0	0	0
Nov '06	11/7	11/7	11/7	11/7
Notes	0	0	0	0
Dec '06	12/6	12/6	12/6	12/6
Notes	0	0	0	0

If there is anything not working properly - please note on this sheet & report to safety person

United Rentals  
 788 W Ridge Rd  
 Rochester Ny 14615

4 pm

4/24/07

ATH: SIMS  
ALICOM

Monthly Inspection of Emergency Lights - 2007

- 1 - Above window in showroom
- 1 Emergency light in hallway to back
- 1 Emergency light above door to back
- 1 Above Blue door in shop area

Please insert actual date inspected & check off each light in column

Date Inspected	Hallway Light	Light Above Door to Shop	Window Showroom	Blue Door to Exit Shop
Jan-07	1/9	1/9	1/9	1/9
Notes	C	C	C	C
Feb '07	2/6	2/6	2/6	2/6
Notes	C	C	C	C
March '07	3/7	3/7	3/7	3/7
Notes	C	C	C	C
April '07	4/5	4/5	4/5	4/5
Notes	C	C	C	C
May '07				
Notes				
June '07				
Notes				
July '07				
Notes				
August '07				
Notes				
Sept '07				
Notes				
Oct '07				
Notes				
Nov '07				
Notes				
Dec '07				
Notes				

Fire Protection Spk  
Due 5/16/07

Emergency and Dry Chemical  
System Repair  
Due 06/07

2006 light inspection

+ 2007 light inspection

If there is anything not working properly - please note on this sheet & report to safety person

United Rentals  
788 W Ridge Rd  
Rochester Ny 14615



## NOTICE OF VIOLATION AND ORDER TO COMPLY

UNITED Rentals  
NAME  
744 W. ROSE RD  
ADDRESS  
Roch NY 14615  
CITY, STATE, ZIP

Date 4-15-07

Inspection of the premises located at 744 ROSE RD W reveals violations of the Rochester Fire Prevention Code. Orders are hereby issued for **immediate correction** of violations listed herein. Compliance shall be verified by the Fire Marshal.

Failure to comply with these orders may result in issuance of Municipal Code Violation Ticket with following penalties:

	INITIAL	FAILURE TO RESPOND
1st OFFENSE	\$ 75	\$150
2nd OFFENSE	\$150	\$300
3rd & SUBSEQUENT	\$375	\$750

- ① FIRE ALARM SYSTEM SHALL BE INSPECTED
- ② EMERGENCY LIGHTS SHALL BE INSPECTED
- ③ PROPERTY SHALL BE STORED OUTSIDE AND PROTECTED FROM VEHICLES

Received by: \_\_\_\_\_  
NAME

\_\_\_\_\_  
TITLE

\_\_\_\_\_  
DATE

By Order of  
Fire Marshal

Fire Marshal 

DATE OF COMPLIANCE \_\_\_\_\_

Fire Marshal \_\_\_\_\_

INSPECTION DATE: \_\_\_\_\_

LOCATION: 788 RIDGE

RD W 01 OWNER: UNITED RENTALS  
788 W RIDGE RD  
ROCHESTER MY 14615

OCCUPANT: \_\_\_\_\_ TYPE OF OPERATION: \_\_\_\_\_

PERSON CONTACTED: ~~BOB BROWN~~ *JIM COURTNEY* PHONE NO: 6217318 APPOINTMENT: (Y/N) \_\_\_\_\_

(CONDITIONS, SURROUNDINGS AND ARRANGEMENTS FOUND:

CODE	FEE	PERMIT
5412B10C	70	06132 FLAM/COMB LQD CLS I,II,III
<del>5412B12A</del>	<del>150</del>	<del>FLAM/COMPRESS GAS OVER 2000 CU FT</del>
5412B18	70	ACETYLENE/FLAMMABLE GAS USAGE <i>P. PROPANE</i>
5412B23A	70	PRIVATE PLANT
5412B23B	40	PRIVATE PLANT DISPENSING UNITS

*5412B21A - LPG ~~70~~ 150*

DATE VIOLATIONS ISSUED: \_\_\_\_\_ CORRECTED: \_\_\_\_\_

DATE OF APPROVAL FOR PERMIT: \_\_\_\_\_ SIGNATURE: \_\_\_\_\_

----- FOR OFFICE USE ONLY -----

DATE PERMIT ISSUED: \_\_\_\_\_ DATE EXPIRED: \_\_\_\_\_ 20 \_\_\_\_

PERMIT NUMBER: \_\_\_\_\_ FEE REQD: \_\_\_\_\_





**City of Rochester  
FIRE DEPARTMENT**

**FIRE SAFETY DIVISION**

185 Exchange Blvd., Suite 665  
Rochester, New York 14614  
(585) 428-7037

**PERMIT**

DATE 06/07/06

For keeping, storing, using, installing, manufacturing, handling, transporting, or otherwise employing flammable, combustible, or explosive materials, or materials, processes, or equipment, which if improperly used may produce conditions hazardous to life or property.

TO WHOM IT MAY CONCERN:  
By virtue of the provisions of the Fire Prevention Code of the City of Rochester, NY.,

**UNITED RENTALS**  
788 RIDGE RD W

07-06132	PERMIT NUMBER
----------	---------------

having made application in due form, and as the conditions, surroundings, and arrangements are, in my opinion, such that the intent of the Fire Prevention Code can be observed, authority is hereby given and this PERMIT is GRANTED for:

PERMIT CODE	PERMIT CATEGORY	FEE
5412B10C1	FLAM/COMB LOD CLS I II III	70

**Please return this part with payment**


MAKE YOUR CHECK OR MONEY ORDER, PAID IN FULL,  
PAYABLE TO CITY TREASURER AND MAIL TO:

ROCHESTER FIRE DEPARTMENT  
ATTENTION: ACCOUNTS RECEIVABLE  
185 EXCHANGE BLVD., SUITE 663  
ROCHESTER, NEW YORK 14614

PLEASE WRITE PERMIT NUMBERS  
ON YOUR CHECK OR MONEY ORDER

00788 RIDGE RD W

07-06132	PERMIT NUMBER
06/07/06	INVOICE DATE
07/07/06	DUE DATE
\$ 400	AMOUNT DUE

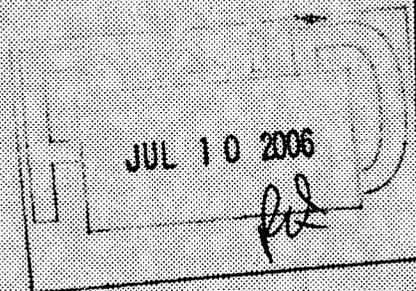

UNITED RENTALS  
788 W RIDGE RD  
ROCHESTER MY 14615

shall be complied with, and said PERMIT will become valid only after receipt of total fee payment.

THIS PERMIT EXPIRES **06/30/07**

This permit does not take the place of any License required by law and is not transferable. Any change in the use or occupancy of premises shall require a new permit.

*James DeGano*  
FIRE MARSHAL

THIS PERMIT MUST AT ALL TIMES BE KEPT ON FILE AT THE PREMISES MENTIONED ABOVE

**Please return this part with payment**

MAKE YOUR CHECK OR MONEY ORDER, PAID IN FULL,  
PAYABLE TO CITY TREASURER AND MAIL TO:

ROCHESTER FIRE DEPARTMENT  
ATTENTION: ACCOUNTS RECEIVABLE  
185 EXCHANGE BLVD., SUITE 663  
ROCHESTER, NEW YORK 14614

PLEASE WRITE PERMIT NUMBERS  
ON YOUR CHECK OR MONEY ORDER

00788 RIDGE RD W

07-06132	PERMIT NUMBER
06/07/06	INVOICE DATE
07/07/06	DUE DATE
\$ 400	AMOUNT DUE

UNITED RENTALS  
788 W RIDGE RD  
ROCHESTER MY 14615

Permit fee payments not received by the due date will be considered delinquent.

These delinquent properties operating with invalid permits will be subject to the issuance of a Municipal Code Violations Summons pursuant to Chapter 54-10 of the Municipal Code.

Municipal Code Summons Schedule

	<b>Initial</b>	<b>Default</b>
<b>1st Offense, or after 30 days</b>	<b>\$ 75.00</b>	<b>\$150.00</b>
<b>2nd Offense, or after 60 days</b>	<b>\$150.00</b>	<b>\$300.00</b>
<b>3rd Offense, or after 90 days</b>	<b>\$375.00</b>	<b>\$750.00</b>



# City of Rochester FIRE DEPARTMENT

FIRE SAFETY DIVISION

185 Exchange Blvd., Suite 665  
Rochester, New York 14614  
(585) 428-7037

## PERMIT

DATE 06/06/05

For keeping, storing, using, installing, manufacturing, handling, transporting, or otherwise employing flammable, combustible, or explosive materials, or materials, processes, or equipment, which if improperly used may produce conditions hazardous to life or property.

**TO WHOM IT MAY CONCERN:**

By virtue of the provisions of the Fire Prevention Code of the City of Rochester, NY.,

**UNITED RENTALS**  
788 RIDGE

RD W

06-06139	PERMIT NUMBER
----------	---------------

having made application in due form, and as the conditions, surroundings, and arrangements are, in my opinion, such that the intent of the Fire Prevention Code can be observed, authority is hereby given and this PERMIT is GRANTED for:

PERMIT CODE	PERMIT CATEGORY	FEE
		\$ 70

**Please return this part with payment**

MAKE YOUR CHECK OR MONEY ORDER, PAID IN FULL,  
PAYABLE TO CITY TREASURER AND MAIL TO:


ROCHESTER FIRE DEPARTMENT  
ATTENTION: ACCOUNTS RECEIVABLE  
185 EXCHANGE BLVD., SUITE 663  
ROCHESTER, NEW YORK 14614

PLEASE WRITE PERMIT NUMBERS

ON YOUR CHECK OR MONEY ORDER

00788 RIDGE

RD W

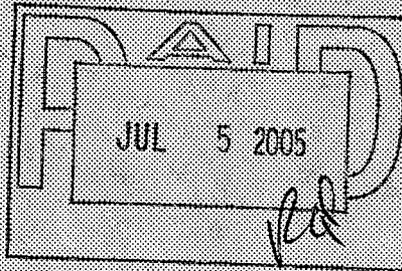

06-06139	PERMIT NUMBER
06/06/05	INVOICE DATE
07/06/05	DUE DATE
\$ 400	AMOUNT DUE

UNITED RENTALS  
788 W RIDGE RD  
ROCHESTER MY 14615

FD513

fdpmt1

This PERMIT is issued and accepted on condition that all Fire Prevention Code provisions now adopted, or that may hereafter be adopted, shall be complied with, and said PERMIT will become valid only after receipt of total fee payment.

THIS PERMIT EXPIRES

06/30/06

This permit does not take the place of any License required by law and is not transferable. Any change in the use or occupancy of premises shall require a new permit.

*James DeGano*  
FIRE MARSHAL

THIS PERMIT MUST AT ALL TIMES BE KEPT ON FILE AT THE PREMISES MENTIONED ABOVE

**Please return this part with payment**

MAKE YOUR CHECK OR MONEY ORDER, PAID IN FULL,  
PAYABLE TO CITY TREASURER AND MAIL TO:

ROCHESTER FIRE DEPARTMENT  
ATTENTION: ACCOUNTS RECEIVABLE  
185 EXCHANGE BLVD., SUITE 663  
ROCHESTER, NEW YORK 14614

PLEASE WRITE PERMIT NUMBERS

ON YOUR CHECK OR MONEY ORDER

00788 RIDGE

RD W

06-06139	PERMIT NUMBER
06/06/05	INVOICE DATE
07/06/05	DUE DATE
\$ 400	AMOUNT DUE

UNITED RENTALS  
788 W RIDGE RD  
ROCHESTER MY 14615

FD513

fdpmt1

Permit fee payments not received by the due date will be considered delinquent.

These delinquent properties operating with invalid permits will be subject to the issuance of a Municipal Code Violations Summons pursuant to Chapter 54-10 of the Municipal Code.

Municipal Code Summons Schedule

	Initial	Default
1st Offense, or after 30 days	\$ 75.00	\$150.00
2nd Offense, or after 60 days	\$150.00	\$300.00
3rd Offense, or after 90 days	\$375.00	\$750.00

---



**City of Rochester  
FIRE DEPARTMENT  
PERMIT**

**FIRE SAFETY DIVISION**

185 Exchange Blvd., Suite 665  
Rochester, New York 14614  
(585) 428-7037

DATE 6/15/04

For keeping, storing, using, installing, manufacturing, handling, transporting, or otherwise employing flammable, combustible, or explosive materials, or materials, process, or equipment, which if improperly used may produce conditions hazardous to life or property.

**TO WHOM IT MAY CONCERN:**

By virtue of the provisions of the Fire Prevention Code of the City of Rochester, NY.,

**UNITED RENTALS**

**Permit Number: 05-06138**

**788 W RIDGE RD**

**Please return this part with payment**

MAKE YOUR CHECK OR MONEY ORDER, PAID IN FULL,  
PAYABLE TO THE CITY TREASURER AND MAIL TO:


PLEASE WRITE PERMIT NUMBERS  
ON YOUR CHECK OR MONEY ORDER

ROCHESTER FIRE DEPARTMENT  
ATTENTION: ACCOUNTS RECEIVABLE  
185 EXCHANGE BLVD., SUITE 663  
ROCHESTER, NEW YORK 14614

Permit for Property at:  
**00788 W RIDGE RD**

05-06138	PERMIT NUMBER
06/15/04	INVOICE DATE
07/15/04	DUE DATE
\$ 350	AMOUNT DUE

**UNITED RENTALS**  
788 W RIDGE RD  
ROCHESTER NY 14615

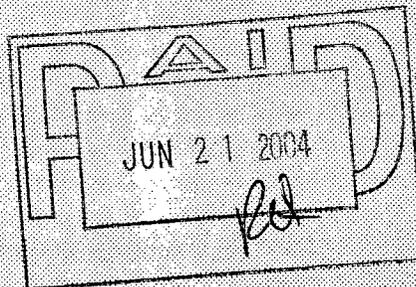

THIS PERMIT is issued and accepted on condition that all Fire Prevention Code provisions now adopted, or that may hereafter be adopted, shall be complied with, and said PERMIT will become valid only after receipt of total fee payment.

**THIS PERMIT EXPIRES: 06/30/05**

This permit does not take the place of any License required by law and is not transferable. Any change in the use or occupancy of premises shall require a new permit.

*Jerome A. [Signature]*  
Fire Marshal

**THIS PERMIT MUST AT ALL TIMES BE KEPT ON FILE AT THE PREMISES MENTIONED ABOVE**

**Please return this part with payment**

MAKE YOUR CHECK OR MONEY ORDER, PAID IN FULL,  
PAYABLE TO THE CITY TREASURER AND MAIL TO:

PLEASE WRITE PERMIT NUMBERS  
ON YOUR CHECK OR MONEY ORDER

ROCHESTER FIRE DEPARTMENT  
ATTENTION: ACCOUNTS RECEIVABLE  
185 EXCHANGE BLVD., SUITE 663  
ROCHESTER, NEW YORK 14614

Permit for Property at:  
**00788 W RIDGE RD**

05-06138	PERMIT NUMBER
06/15/04	INVOICE DATE
07/15/04	DUE DATE
\$ 350	AMOUNT DUE

**UNITED RENTALS**  
788 W RIDGE RD  
ROCHESTER NY 14615

REPORT OF INSPECTION

DATE OF INSPECTION 5/13/04

CUSTOMER: UNITED RENTALS

COMPANY: IRONDEQUOIT FIRE EXT ADDRESS: 788 W. RIDGE RD.

ADDRESS: P.O. BOX 17196 CITY: ROCHESTER NY 14616

CITY: ROCHESTER NY 14617 PHONE #: 621-7318

PHONE #: 752-2053 OWNER/MANAGER: \_\_\_\_\_

REASON FOR REPORT:  INITIAL INSTALLATION  SEMI-ANNUAL INSP.  ANNUAL INSP.  
 OTHER \_\_\_\_\_

SYSTEM MANUFACTURER AND MODEL: Kidde Industrial KRS 7004 cyl.

1. EXTINGUISHING AGENT:  POTASSIUM BICARBONATE  MONAMONIUM PHOSPHATE  
 SODIUM BICARBONATE  POTASSIUM CHLORIDE

2. AMOUNT OF AGENT: 200 POUNDS NUMBER OF CYLINDERS 4

3. NOZZLES: TOTAL NUMBER INSTALLED 16

4. PIPING: CORRECT SIZE  YES  NO, PROPERLY INSTALLED  YES  NO, FREE OF PHYSICAL DEFECT/OBSTRUCTIONS  YES  NO

5. DETECTION DEVICES:  FUSIBLE METAL ALLOY TYPE LINKS,  BULB TYPE  HEAT DETECTOR  
OTHER \_\_\_\_\_ TEMPERATURE RATING 194°

6. AREA PROTECTED: Overhead w/ End of Island Aul Ground sweep.

7. EXPELLANT:  CARBON DIOXIDE CARTRIDGE \_\_\_\_\_ WT.  NITROGEN CARTRIDGE \_\_\_\_\_ PSI  
STORED PRESSURE CYLINDER 760\* PSI

8. AUTOMATIC SHUTDOWN:  YES  NO, FOR All Pumps

9. MANUAL RELEASE: PROPER LOCATION  YES  NO, PROPER OPERATION  YES  NO

10. HYDROSTATIC TEST DATE: DATE OF HYDROSTATIC TEST 2002<sup>new</sup> THE FOLLOWING DEVICES WERE TESTED  PRESSURE CYL.  AGENT CYL.  HOSE AND FITTINGS  
 AUXILIARY PRESSURE CONTAINERS  OTHER \_\_\_\_\_

11. ALARM: THE SUPPRESSION SYSTEM ACTIVATES THE FIRE ALARM SYSTEM WHEN OPERATED  
 YES  NO

12. REMARKS: \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

CARMIN GALLO  
SERVICE COMPANY - TECHNICIAN

5/13/04 DATE  
12:00 PM TIME

[Signature]  
CUSTOMERS AUTHORIZED AGENT

IRONDEQUOIT FIRE EXT. C.O.

Rochester Fire Department  
185 Exchange Blvd., Suite 665  
Rochester, New York 14614



OFFICE OF THE FIRE MARSHAL  
Telephone: 428-7037  
Fax: 428-6785

## NOTICE OF VIOLATION AND ORDER TO COMPLY

UNITED Rentals  
NAME

Date 5-12-04

788 W. RIDGE RD  
ADDRESS

ROCH N.Y. 14615  
CITY, STATE, ZIP

Inspection of the premises located at 788 RIDGE RD W reveals violations of the Rochester Fire Prevention Code. Orders are hereby issued for immediate correction of violations listed herein. Compliance shall be verified by the Fire Marshal.

Failure to comply with these orders may result in issuance of Municipal Code Violation Ticket with following penalties:

	INITIAL	FAILURE TO RESPOND
1st OFFENSE	\$ 75	\$150
2nd OFFENSE	\$150	\$300
3rd & SUBSEQUENT	\$375	\$750

① FIRE ALARM SYSTEM SHALL BE INSPECTED RESULTS SHALL BE GIVEN TO THE FIRE DEPT

② PROPANE SHALL BE REMOVED FROM INSIDE THE BUILDING

③ PROPANE SHALL BE PROPERLY SECURED AND PROTECTED

④ FUEL SUPPRESSION SYSTEM SHALL AN UPDATED INSPECTION TAG <sup>HAVE</sup>

Received by: \_\_\_\_\_  
NAME

\_\_\_\_\_  
TITLE

\_\_\_\_\_  
DATE

By Order of  
Fire Marshal

Fire Marshal 

DATE OF COMPLIANCE \_\_\_\_\_

Fire Marshal \_\_\_\_\_



E-10 Sam

# FIRE SAFETY INSPECTION RECORD

- LICENSE
- PERMIT
- EAST
- WEST
- SPECIAL

LOCATION: 788 Ridge Rd West

Person contacted:

Telephone #:

4/21/04

DATE RECEIVED IN FIRE SAFETY:

TIME OF INSPECTION

NO ENTRY

# ORDERS ISSUED

# REFERRALS ISSUED

NO WORK DONE

# VIOLATIONS CORRECT

NO VIOLATIONS NOTED

DATE

NOTES

OK TO FILE

INSPECTOR

5-10-04

5-17-04

6-11-04

*[Handwritten signature]*

*[Handwritten signature]*

*[Handwritten signature]*

Y N

- SPRINKLER SYSTEM
- COOKING HOOD SYSTEM
- FIRE ALARM SYSTEM
- STANDPIPE SYSTEM
- COOKING SYSTEM
- BARS/WIRE ON WINDOWS

APPROVED  
FIRE SAFETY DIVISION

FIRE MARSHAL



City of Rochester  
**FIRE DEPARTMENT**  
**PERMIT**

**FIRE SAFETY DIVISION**

185 Exchange Blvd., Suite 665  
 Rochester, New York 14614  
 (585) 428-7037

DATE 07/10/03

For keeping, storing, using, installing, manufacturing, handling, transporting, or otherwise employing flammable, combustible, or explosive materials, or materials, process, or equipment, which if improperly used may produce conditions hazardous to life or property.

**TO WHOM IT MAY CONCERN:**

By virtue of the provisions of the Fire Prevention Code of the City of Rochester, NY.,

**UNITED RENTALS**

**Permit Number: 04-06118**

788 RIDGE RD W

having made application in due from, and as the conditions, surroundings, and arrangements are, in my opinion, such that the intent of the Fire Prevention Code can be observed, authority is hereby give and this PERMIT is GRANTED for:

PERMIT CODE	PERMIT CATEGORY	FEE
5412B10C1	FLAMMABLE / COMBUSTIBLE LIQUIDS CLASS I, II, III	\$ 60
5412B12A	FLAMMABLE / COMPRESS GAS OVER 2000 CU FT	\$130
5412B18	ACETYLENE / FLAMMABLE GAS USAGE WITH WELDING / CUTTING	\$ 60
5412B24	PRIVATE PLANT	\$100
<b>TOTAL</b>		<b>\$ 350</b>

This PERMIT is issued and accepted on condition that all Fire Prevention Code provisions now adopted, or that may hereafter be adopted, shall be complied with, and said PERMIT will become valid only after receipt of total fee payment.

**THIS PERMIT EXPIRES: 06/30/04**

This permit does not take the place of any License required by law and is not transferable. Any change in the use or occupancy of premises shall require a new permit.

*Jerome S. Lyons*  
 Fire Marshal


**THIS PERMIT MUST AT ALL TIMES BE KEPT ON FILE AT THE PREMISES MENTIONED ABOVE**

**Please return this part with payment**

MAKE YOUR CHECK OR MONEY ORDER, PAID IN FULL,  
 PAYABLE TO THE CITY TREASURER AND MAIL TO:

PLEASE WRITE PERMIT NUMBERS  
 ON YOUR CHECK OR MONEY ORDER

ROCHESTER FIRE DEPARTMENT  
 ATTENTION: ACCOUNTS RECEIVABLE  
 185 EXCHANGE BLVD., SUITE 663  
 ROCHESTER, NEW YORK 14614

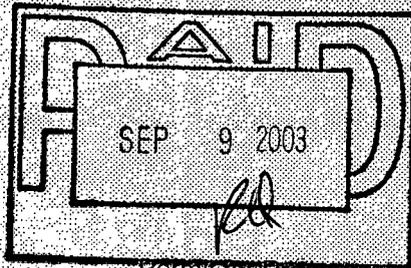

04-06118	PERMIT NUMBER
07/10/03	INVOICE DATE
08/10/03	DUE DATE
\$ 350	AMOUNT DUE

UNITED RENTALS  
 788 RIDGE RD W  
 ROCHESTER NY 14615

Permit for Property at  
 00788 RIDGE RD W



## City of Rochester



(585) 428-6739  
(585) 428-6785 FAX

Fire Safety Division  
Fire Department

185 Exchange Blvd.  
Room 665  
Rochester, New York 14614-1283

September 3, 2003

United Rentals  
788 Ridge Rd. W  
Rochester, NY 14615

To Whom It May Concern:

This letter is to inform you that your Fire Safety Permit for the business at 788 W Ridge Rd. is delinquent for nonpayment. The amount of the permit is \$350.00. This is a final courtesy notice.

**We must receive your payment of \$350.00 within five (5) days of the date of this letter or we will issue a Summons for a violation of the Municipal Code. The fee for a Summons violation is as follows:**

First Offense	\$ 75.00
Second Offense	\$ 150.00
Third Offense	\$ 375.00

Time is of the essence, please remit your payment payable to the City Treasurer and mail it to the following address immediately:

Rochester Fire Department  
Attention: Accounts Receivable  
185 Exchange Boulevard, suite 665  
Rochester, New York 14614

If you have any questions, please contact me at 428-7037. We will appreciate your prompt compliance to this letter.

Sincerely,

James Sands,  
Code Enforcement Officer

JS:cm  
Enclosure: Copy of Permit Statement





## NOTICE OF VIOLATION AND ORDER TO COMPLY

UNITED RENTALS  
NAME  
788 W. RIDGE RD.  
ADDRESS  
14615  
CITY, STATE, ZIP

Date 5/20/03

Inspection of the premises located at SAME reveals violations of the Rochester Fire Prevention Code. Orders are hereby issued for **immediate correction** of violations listed herein. Compliance shall be verified by the Fire Marshal.

Failure to comply with these orders may result in issuance of Municipal Code Violation Ticket with following penalties:

	SOLUTIONS 247-3480	INITIAL	FAILURE TO RESPOND
1st OFFENSE		\$ 75	\$150
2nd OFFENSE		\$150	\$300
3rd & SUBSEQUENT		\$375	\$750

5/28/03

- 1 901.6.1  Fire alarm system shall be tested / inspected with report available.
- 1 OK - all fire extinguishers shall be mounted on a bracket.
- 1 OK 4/25/03 emergency lights shall be tested monthly with report available.
- 1 3003.3.3  all (empty / filled) compressed gas cylinders shall be secured / chained.
- 1 3009.2  - large LPG container shall be removed from gas pump area and stored in a safe secure area.

Received by: \_\_\_\_\_ NAME \_\_\_\_\_ TITLE \_\_\_\_\_ DATE

By Order of  
 Fire Marshal

Fire Marshal MARK S. CALDWELL

DATE OF COMPLIANCE 7/3/03

Fire Marshal [Signature]

INSPECTION DATE: 5/19/03

LOCATION: 788 RIDGE RD W 01 OWNER: UNITED RENTALS  
788 W RIDGE RD  
ROCHESTER MY 14615

OCCUPANT: \_\_\_\_\_ TYPE OF OPERATION: \_\_\_\_\_

PERSON CONTACTED: ~~STEVE ERICKSON~~ PHONE NO: 6217318 APPOINTMENT: (Y/N) \_\_\_\_\_  
BOB BROWN

(CONDITIONS, SURROUNDINGS AND ARRANGEMENTS FOUND:

CODE	FEE	PERMIT
5412B10C	<u>OK</u> 60	06117 FLAM/COMB LQD CLS I,II,III
5412B12A	<u>OK</u> 130	FLAM/COMPRESS GAS-OVER 2000 CU FT
5412B18	<u>OK</u> 60	ACETYLENE/FLAMMABLE GAS USAGE
5412B24	<del>80</del> <u>100</u>	PRIVATE PLANT

*OK*

DATE VIOLATIONS ISSUED: 5/19 20 03 CORRECTED: 7/3 20 03  
DATE OF APPROVAL FOR PERMIT: 7/3 20 03 SIGNATURE: [Signature]

----- FOR OFFICE USE ONLY -----

DATE PERMIT ISSUED: \_\_\_\_\_ 20 \_\_\_\_\_ DATE EXPIRED: \_\_\_\_\_ 20 \_\_\_\_\_  
PERMIT NUMBER: \_\_\_\_\_ FEE REQD: \_\_\_\_\_

FIRE SAFETY INSPECTION RECORD

Mark 4/22/03  
 LICENSE GENERAL  
 PUBLIC ED  
 PERMIT  
 HIGH-RISE

LOCATION

788 Ridge Rd. W.

DATE RECEIVED IN FIRE SAFETY:

APR 11 2003

DATE

APPOINTMENT

PERSON CONTACTED

NO ENTRY

ORDERS ISSUED

REFERRALS ISSUED

NO WORK DONE

SOME WORK DONE

OTHER

OK TO FILE

INSPEC

Bob Brown

5/19/03

5

MS

~~5/29/03~~

6/25/03

4

MS

~~7/2/03~~

- have a light report fixed.

7/3/03

1

X MS

Owner's Name

Home Addresss & Zip

Home Phone #

pump supp syst. - 12/02

Y N

SPRINKLER SYSTEM

REPORT - YES NO

COOKING HOOD SYSTEM

DATE \_\_\_\_\_

FIRE ALARM SYSTEM

PERMIT # \_\_\_\_\_

STANDPIPE SYSTEM

REPORT - YES NO

COOKING SYSTEM

BARS/WIRE ON WINDOWS

✓ fire alarm report

✓ emerg. light report / test

✓ - mount fire ext's (2)

✓ secure/protect empty 60 lb LPG's.

✓ - remove large LPG tank next to pop.

✓ 1000 g

✓ 2 nozzles

FIRE SAFETY INSPECTION RECORD

LICENSE

GENERAL  
PUBLIC ED  
PERMIT  
HIGH-RISE

788

LOCATION

~~788~~ W. RIDGE RD.

DATE RECEIVED IN FIRE SAFETY:	APPOINTMENT	PERSON CONTACTED	NO ENTRY	ORDERS ISSUED	REFERRALS ISSUED	NO WORK DONE	SOME WORK DONE	OTHER	OK TO FILE	INSPECTOR
		TOM MERLER						OKAR 436-7503 X134		
DATE		TODD PEDEVILLE						370-2698		
5/24/02	11:00							TANK TEST (2) 500 gal. tanks		MS
6/3/02	3:00							PUFF TEST - INSPECT & WRITE UP NEW PERMITS.		MS
6/6/02								- need papers from OKAR & ROOF-FIRE EQ. - have all reports now.		MS

Owner's Name

Home

Home

Steve Erickson  
Operations Manager



United Rentals  
(North America), Inc.  
788 West Ridge Road  
Rochester, NY 14615

Bus (585) 621-7318  
Fax (585) 621-6626  
Toll Free (800) UR-RENTS  
Cell (585) 281-0373

E-mail serickso@ur.com

Y N

SPRINKLER SYSTEM

REPORT - YES NO

COOKING HOOD SYSTEM

DATE

FIRE ALARM SYSTEM

PERMIT # NEW

STANDPIPE SYSTEM

REPORT - YES NO

COOKING SYSTEM

BARS/WIRE ON WINDOWS



**City of Rochester  
FIRE DEPARTMENT**

**FIRE SAFETY DIVISION**

300 Public Safety Building  
Rochester, New York 14614  
(585) 428-7037

DATE 06/18/02

**PERMIT**

For keeping, storing, using, installing, manufacturing, handling, transporting, or otherwise employing flammable, combustible, or explosive materials, or materials, processes, or equipment, which if improperly used may produce conditions hazardous to life or property.

TO WHOM IT MAY CONCERN:

By virtue of the provisions of the Fire Prevention Code of the City of Rochester, NY.,

**UNITED RENTALS  
788 RIDGE**

**RD W**

<b>03-06117</b>	<b>PERMIT NUMBER</b>
-----------------	--------------------------

having made application in due form, and as the conditions, surroundings, and arrangements are, in my opinion, such that the intent of the Fire Prevention Code can be observed, authority is hereby given and this PERMIT is GRANTED for:

PERMIT CODE	PERMIT CATEGORY	FEE
5412B10C1	FLAM/COMB LQD STORAGE CLS I,II,III	\$ 50
5412B12A		\$ 100
5412B18		\$ 50
5412B24		\$ 80
		<b>TOTAL \$ 280</b>

This PERMIT is issued and accepted on condition that all Fire Prevention Code provisions now adopted, or that may hereafter be adopted, shall be complied with, and said PERMIT will become valid only after receipt of total fee payment.

THIS PERMIT EXPIRES **06/30/03**

This permit does not take the place of any License required by law and is not transferable. Any change in the use or occupancy of premises shall require a new permit.

*Jeanne DeGuz*  
FIRE MARSHAL

THIS PERMIT MUST AT ALL TIMES BE KEPT ON FILE AT THE PREMISES MENTIONED ABOVE

**Please return this part with payment - when paid**

MAIL YOUR CHECK OR PRESENT THIS INVOICE WITH FEE PAID IN FULL TO:

**CITY TREASURER** 00788 RIDGE RD W  
ROOM 100A, CITY HALL  
ROCHESTER, NEW YORK 14614

03-06117	PERMIT NUMBER
06/18/02	INVOICE DATE
07/19/02	DUE DATE
\$ 280	AMOUNT DUE

*paid 8/6/02  
RA*

**UNITED RENTALS  
788 W RIDGE ROAD  
ROCHESTER MY 14615**

Permit fee payments not received by the due date will be considered delinquent.

These delinquent properties operating with invalid permits will be subject to the issuance of a Municipal Code Violations Summons pursuant to Chapter 54-10 of the Municipal Code.

Municipal Code Summons Schedule

	Initial	Default
1st Offense, or after 30 days	\$ 75.00	\$150.00
2nd Offense, or after 60 days	\$150.00	\$300.00
3rd Offense, or after 90 days	\$375.00	\$750.00

# Rockwell Fire EQUIPMENT CO., INC.

64 MARSHALL ST.  
ROCHESTER, NY 14607  
(716) 546-6765 • FAX (716) 546-6849

## GAS STATION FIRE SYSTEM INSPECTION REPORT

SERVICE TECH. Joe Lissow TRUCK System DATE 6/3/02  
 CUSTOMER NAME United Rentals  
 STREET/P.O. BOX 788 Ridge Rd.  
 CITY Rochester STATE N.Y. ZIP CODE \_\_\_\_\_  
 SERVICE INTERVAL - SEMI ANNUAL \_\_\_\_\_ OTHER \*New Installation  
 NUMBER OF FUEL ISLANDS 2  
 NUMBER OF FUEL DISPENSERS 2  
 TYPE OF HAZARD - GASOLINE X DIESEL X KEROSENE \_\_\_\_\_ OTHER \_\_\_\_\_  
 MFG. OF SYSTEM Kidde MODEL # KRS-190  
 SERIAL # \_\_\_\_\_ SIZE OF SYSTEM 3/50#, 1/25#  
 TYPE OF DRY CHEMICAL - ABC \_\_\_\_\_ BC X PURPLE-K \_\_\_\_\_ OTHER \_\_\_\_\_  
 LAST HYDROSTATIC TEST DATE OF CYLINDERS 2002  
 LAST 6-YEAR MAINTENANCE DATE OF CYLINDERS 2002  
 TYPE OF COVERAGE:  
 OVERHEAD ISLAND AND PARKING AREA X  
 OVERHEAD END OF ISLAND X  
 GROUND SWEEP X


**INSPECTION PROCEDURE:**

- VERIFY INSPECTION WITH PROPER AUTHORITY X
- CHECK CYLINDERS FOR PROPER PRESSURES X
- CHECK PIPING X MEETS MFG. SPECS. YES X NO \_\_\_\_\_
- CHECK NOZZLES FOR OBSTRUCTIONS X
- CHECK NOZZLE CAPS AND REPLACE IF NECESSARY X
- CHECK HEAT DETECTOR ACTUATION X
- CHECK REMOTE MANUAL RELEASE ACTUATION X
- CHECK CONTROL HEAD(S) FOR PROPER OPERATION X
- CHECK FUEL DISPENSER SHUT DOWN FOR PROPER OPERATION \_\_\_\_\_
- SYSTEM HAS BEEN TEST TRIPPED? YES X NO \_\_\_\_\_
- SYSTEM MEETS NFPA 17 STANDARDS? YES X NO \_\_\_\_\_

COMMENTS: \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_

RECOMMENDATIONS:

~~ADDITIONAL COVERAGE NEEDED \_\_\_\_\_~~  
~~ADDITIONAL HEAT DETECTORS NEEDED \_\_\_\_\_~~  
~~FUEL DISPENSER SHUT DOWN NEEDED \_\_\_\_\_~~  
~~CYLINDERS REQUIRE HYDROTEST \_\_\_\_\_~~  
~~CYLINDERS REQUIRE 6-YEAR MAINTENANCE \_\_\_\_\_~~  
~~OTHER \_\_\_\_\_~~  
~~RECOMMEND UPGRADING OF SYSTEM \_\_\_\_\_~~  
COMMENTS: \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_



SIGNATURE: [Handwritten Signature]  
TITLE: Fire System Tech.  
DATE: 6/3/02



# OKAR EQUIPMENT CO.

• 768 BROOKS AVENUE • ROCHESTER, NEW YORK 14619-0700

(585) 436-7503 • 800-333-0685 • FAX (585) 328-3989 • www.okarequipment.com

INDUSTRIAL • AUTOMOTIVE • PETROLEUM EQUIPMENT • PARTS, SALES, INSTALLATION & SERVICE

Fax Transmission from (585) 328-3989

To: City of Rochester Fire Dept Number of Pages: \_\_\_\_\_

Attn: MARK SCINDONE Hard Copy Mailed:  Yes  No

Fax #: \_\_\_\_\_

Date: 6-5-02

From: TOM MERCER

*Thurs 18<sup>th</sup>*

Message:

MARK,  
ENCLOSED IS INFO ON TANKS FOR  
YOUR RECORDS. PLEASE CALL IF YOU NEED

If there is a problem in the transmission of this fax, or you don't receive all of the pages, please call (585) 436-7503.

## Requires Tank Owner Action - Fireguard® Limited Warranty Validation Card

Please complete this form to validate your Limited Warranty. This card must be completely and accurately filled out and returned to STI within 30 days after the tank is installed, or within 90 days after the tank is shipped from the manufacturer, whichever comes first. By signing this form, the tank owner verifies that the tank was installed in accordance with STI Installation Instructions, the product stored is compatible with the tank, and the owner has read and agrees with the terms of the Limited Warranty included with this form. RETURN TO: STEEL TANK INSTITUTE, 570 OAKWOOD ROAD, LAKE ZURICH, IL 60047, 847/436-8265

UL 469879

Fireguard® Label Number 15364 Shipment Date 5-23-02

Manufacturer Name Highland Tank & Mfg. Co. Installed Date 6-3-02  
60 W. Elizabethtown Road  
Marion, PA 17546-8110

Tank Installed Location: UNITED RENTALS

Street Name & Number: 788 W. RIDGE RD.  
(Name of Facility)

City: ROCHESTER State: NY Zip: 14619 Country: USA

Contact Name: STEVE Phone: 716-621-7318

Installer Name: OKAR EQUIPMENT CO Phone: 716-436-7503

Owner Name & Mailing Address: COSTANZA ENTERPRISES

P.O. Box or Street Address: 14 FRANKLIN ST, SUITE 800  
(If Different from Above)

City: ROCHESTER State: N.Y. Zip: 14604

**Check Product Stored:**

- Wastewater or Water  
 Heating Oil (petroleum #1, #2, #4, #5 heavy or #6)  
 Diesel fuel or kerosene for powering motor vehicles  
 Crude Oil  
 Waste Oil  
 Gasoline  
 Alcohol Blended Gasoline  
 AVGAS or Jet Fuel  
 Oil/Water Separator  
 Product which is heated during storage

**Check Type of Facility Where Tank is Installed:**

- |   |  |
|---|--|
| <input type="checkbox"/> Private Residence                | <input type="checkbox"/> Hospital        |
| <input type="checkbox"/> Farm/Nursery                     | <input type="checkbox"/> School          |
| <input type="checkbox"/> Gas Station                      | <input type="checkbox"/> Government      |
| <input type="checkbox"/> Convenience Store                | <input type="checkbox"/> Marina          |
| <input type="checkbox"/> Jobber                           | <input type="checkbox"/> Airport         |
| <input type="checkbox"/> Quick Lube                       | <input type="checkbox"/> Industrial Site |
| <input type="checkbox"/> Car Dealer                       | <input type="checkbox"/> Utility Site    |
| <input type="checkbox"/> Fleet Owner                      |  |
| <input type="checkbox"/> Other <u>CONSTRUCTION RENTAL</u> |  |
| <input type="checkbox"/> Other substance:                 |  |

My signature below verifies that the tank was installed in accordance with STI installation Instructions, the product stored is compatible with the tank and I have read and agree with the terms of the Limited Warranty provided with this document.

Signature: Todd Pedeville Date 6-5-02

Print Name: Todd Pedeville (REQUIRED)

Company Name: OKAR EQUIPMENT CO.

Phone #: 716-436-07503

**Requires Tank Owner Action - Fireguard® Limited Warranty Validation Card**

Please complete this form to validate your Limited Warranty. This card must be completely and accurately filled out and returned to STI within 30 days after the tank is installed, or within 90 days after the tank is shipped from the manufacturer, whichever comes first. By signing this form, the tank owner verifies that the tank was installed in accordance with STI Installation Instructions, the product stored is compatible with the tank, and the owner has read and agrees with the terms of the Limited Warranty included with this form. RETURN TO: STEEL TANK INSTITUTE, 570 OAKWOOD ROAD, LAKE ZURICH, IL 60047. 847/438-8265

*LIC 4109880*

Fireguard® Label Number 15365 Shipment Date 5-23-02

Manufacturer Name Highland Tank & Mfg. Co. Installed Date 6-3-02  
90 W. Elizabethtown Road  
Manheim, PA 17545, GA 10

Tank Installed Location: UNITED RENTALS  
(Name of Facility)  
 Street Name & Number: 789 W. Ridge Rd.  
 City: Rochester State: N.Y. Zip: 14619 Country: USA

Contact Name: Steve - Mgr Phone: 716-621-7318  
 Installer Name: OKAR Equipment Co Phone: 716-436-7503

Owner Name & Mailing Address: COSTANCA ENTERPRISES  
(If Different from Above)  
 P.O. Box or Street Address: 14 FRANKLIN ST. SUITE 800  
 City: Rochester State: N.Y. Zip: 14604

- Check Product Stored:**
- Wastewater or Water
  - Heating Oil (petroleum #1, #2, #4, #5 heavy or #6)
  - Diesel fuel or kerosene for powering motor vehicles
  - Crude Oil
  - Waste Oil
  - Gasoline
  - Alcohol Blended Gasoline
  - AVGAS or Jet Fuel
  - Oil/Water Separator
  - Product which is heated during storage

- Check Type of Facility Where Tank Is Installed:**
- |   |  |
|---|--|
| <input type="checkbox"/> Private Residence                | <input type="checkbox"/> Hospital        |
| <input type="checkbox"/> Farm/Nursery                     | <input type="checkbox"/> School          |
| <input type="checkbox"/> Gas Station                      | <input type="checkbox"/> Government      |
| <input type="checkbox"/> Convenience Store                | <input type="checkbox"/> Marina          |
| <input type="checkbox"/> Jobber                           | <input type="checkbox"/> Airport         |
| <input type="checkbox"/> Quick Lube                       | <input type="checkbox"/> Industrial Site |
| <input type="checkbox"/> Car Dealer                       | <input type="checkbox"/> Utility Site    |
| <input type="checkbox"/> Fleet Owner                      |  |
| <input type="checkbox"/> Other <u>CONSTRUCTION RENTAL</u> |  |
| <input type="checkbox"/> Other substance:                 |  |

My signature below verifies that the tank was installed in accordance with STI installation Instructions, the product stored is compatible with the tank and I have read and agree with the terms of the Limited Warranty provided with this document.

Signature: Todd Redeville Date: \_\_\_\_\_

Print Name: Todd Redeville (REQUIRED)

Company Name: \_\_\_\_\_

Phone #: \_\_\_\_\_

BUILDING INSPECTION / COMPLAINT FORM



COMPANY Etc INSPECTION # **01 - 11832**  
 ADDRESS RIDGE RD W FROM / TO 788 TAX ACCT #  
 PROPERTY OWNER ADDRESS PHONE 600-0000  
 CITY STATE ZIP  
 MAILING NAME ADDRESS PHONE  
 CITY STATE ZIP  
 EMERGENCY CONTACT ADDRESS PHONE  
RICHARD C. MACK 385 PHELPS RD 533-1372  
 CITY HONEOYE FALLS STATE NY ZIP 14472

NFPA 901 CODES GENERAL PROPERTY USE 52 SPECIFIC PROPERTY USE 591 STRUCTURE TYPE 1 STRUCTURE STATUS 2

NO ENTRY DATES:  
 A = ATTIC  
 C = CELLAR  
 G = GARAGE  
 O = OUTSIDE  
 # = FLOOR #

DIRECTION ROOM #, ETC.

BUSINESS NAME \_\_\_\_\_ PHONE \_\_\_\_\_  
 BUSINESS OWNER \_\_\_\_\_  
 ADDRESS \_\_\_\_\_ PHONE \_\_\_\_\_  
 BUSINESS EMERGENCY \_\_\_\_\_  
 ADDRESS \_\_\_\_\_ PHONE \_\_\_\_\_

SPECIAL INSTRUCTIONS:  
 SPECIAL HARZARDS OR CONSTRUCTION

COMPLAINT

NO VIOLATIONS NOTED AT THIS TIME  A  B  C  D

*Vazant*

DISPOSITION by FIRE SAFETY:  
 REFERRED ORDERS ISSUED CORRECTED NOT REQUIRED

Y N	Y N	Y N
<input type="checkbox"/> <input type="checkbox"/> SPRINKLER SYSTEM	<input type="checkbox"/> <input type="checkbox"/> FIRE/SMOKE DETECT. SYSTEM	<input type="checkbox"/> <input type="checkbox"/> SINGLE STATION SMOKE DETECTORS
<input type="checkbox"/> <input type="checkbox"/> STANDPIPE SYSTEM	<input type="checkbox"/> <input type="checkbox"/> KITCHEN HOOD EXTING. SYSTEM	<input type="checkbox"/> <input type="checkbox"/> BARS/WIRE ON WINDOWS
<input type="checkbox"/> <input type="checkbox"/> FIRE ALARM SYSTEM	<input type="checkbox"/> <input type="checkbox"/> OTHER FIRE EXTING. SYSTEM	<input type="checkbox"/> <input type="checkbox"/> LOCK BOX
OFFICER PREPARING REPORT: <i>LT [Signature]</i>	COMPANY <u>E-10</u>	DISTRICT <u>1</u>
BUS/PROP REPRESENTATIVE:	GROUP <u>4</u>	DATE <u>5-22-01</u>
FIRE SAFETY INSPECTOR:	POSITION / TITLE	DATE OF REINSPECTION
		DATE

BUILDING INSPECTION / COMPLAINT FORM



COMPANY E10  
ADDRESS RIDGE RD W

INSPECTION # 98 - 02403  
TAX ACCT #

PROPERTY OWNER  
C P WARD INC.

FROM / TO 788  
ADDRESS 300 W. RIDGE RD  
CITY ROCHESTER STATE NY ZIP 14615  
PHONE 621-5450

MAILING NAME

ADDRESS  
CITY STATE ZIP PHONE  
ADDRESS  
CITY STATE ZIP PHONE  
ADDRESS 385 PHELPS RD  
CITY HONEOYE FALLS STATE NY ZIP 14472  
PHONE 533-1392

EMERGENCY CONTACT  
RICHARD C. MACK

NFPA 901 CODES	GENERAL PROPERTY USE <u>80</u>	SPECIFIC PROPERTY USE <u>891</u>	STRUCTURE TYPE <u>2</u>	STRUCTURE STATUS <u>2</u>
----------------	--------------------------------	----------------------------------	-------------------------	---------------------------

NO ENTRY DATES:  A = ATTIC C = CELLAR G = GARAGE O = OUTSIDE # = FLOOR #	BUSINESS NAME	PHONE	DISPOSITION by FIRE SAFETY:			
	BUSINESS OWNER ADDRESS	PHONE				
	BUSINESS EMERGENCY ADDRESS	PHONE	REFERRED	ORDERS ISSUED	CORRECTED	NOT REQUIRED
	SPECIAL INSTRUCTIONS:					
	SPECIAL HARZARDS OR CONSTRUCTION					
DIRECTION ROOM #, ETC.	COMPLAINT					
	<input type="checkbox"/> NO VIOLATIONS NOTED AT THIS TIME					
	CURRENTLY VACATING THE PROPERTY - SHOULD BE OUT NEXT WEEK - PROPERTY MAYBE SOLD & THE BUILDING TORN DOWN - Deal PENDING - ?					
	FILE					

OFFICER PREPARING REPORT: <i>Capt. MARTIN McMillan</i>	COMPANY E-10	DISTRICT 1	GROUP 3	DATE 5-29-98
BUS/PROP REPRESENTATIVE:	POSITION / TITLE			DATE OF REINSPECTION
FIRE SAFETY INSPECTOR:				DATE

RFD 501 REV. 12/97

INSPECTION DATE: 6-10-98

LOCATION: 788 RIDGE

RD W 01 OWNER: WARD, C P INC  
P O BOX 900  
SCOTTSVILLE NY 14546

OCCUPANT: \_\_\_\_\_ TYPE OF OPERATION: \_\_\_\_\_

PERSON CONTACTED: ROY PHONE NO: 6215453 APPOINTMENT: (Y/N) \_\_\_\_\_

CONDITIONS, SURROUNDINGS AND ARRANGEMENTS FOUND:

CODE	FEE	PERMIT
5412B08	80	08079 DUST PRODUCING OPERATION
5412B10A	50	FLAMMABLE LQD STORAGE - CLS I
5412B10B	50	CMBSTBLE LQD STORAGE - CLS II,III
5412B18	50	ACETYLENE/FLAMMABLE GAS USAGE
5412B24	65	PRIVATE PLANT

*OUT OF BUSINESS*

**NEW INFORMATION**

DATE VIOLATIONS ISSUED: \_\_\_\_\_ 19 \_\_\_\_\_ CORRECTED: \_\_\_\_\_ 19 \_\_\_\_\_

DATE OF APPROVAL FOR PERMIT: \_\_\_\_\_ 19 \_\_\_\_\_ SIGNATURE: \_\_\_\_\_

FOR OFFICE USE ONLY

DATE PERMIT ISSUED: \_\_\_\_\_ 19 \_\_\_\_\_ DATE EXPIRED: \_\_\_\_\_ 19 \_\_\_\_\_

PERMIT NUMBER: \_\_\_\_\_ FEE REQD: \_\_\_\_\_

INSPECTION DATE: 6-10-98

LOCATION: 788 RIDGE RD W 01 OWNER: WARD, C P INC  
P O BOX 900  
SCOTTSVILLE NY 14546

OCCUPANT: \_\_\_\_\_ TYPE OF OPERATION: \_\_\_\_\_

PERSON CONTACTED: ROY PHONE NO: 6215453 APPOINTMENT: (Y/N) \_\_\_\_\_

(CONDITIONS, SURROUNDINGS AND ARRANGEMENTS FOUND:

CODE	FEE	PERMIT
5412B08	80	08079 DUST PRODUCING OPERATION
5412B10A	50	FLAMMABLE LQD STORAGE - CLS I
5412B10B	50	CMBSTBLE LQD STORAGE - CLS II,III
5412B18	50	ACETYLENE/FLAMMABLE GAS USAGE
5412B24	65	PRIVATE PLANT

*Moving TO SCOTTSVILLE  
SHOULD BE COMPLETE BY  
NEXT WEEK, TO BE TURN  
Over*

**NEW  
INFORMATION**

DATE VIOLATIONS ISSUED: \_\_\_\_\_ 19 \_\_\_\_\_ CORRECTED: \_\_\_\_\_ 19 \_\_\_\_\_

DATE OF APPROVAL FOR PERMIT: \_\_\_\_\_ 19 \_\_\_\_\_ SIGNATURE: \_\_\_\_\_

FOR OFFICE USE ONLY

DATE PERMIT ISSUED: \_\_\_\_\_ 19 \_\_\_\_\_ DATE EXPIRED: \_\_\_\_\_ 19 \_\_\_\_\_

PERMIT NUMBER: \_\_\_\_\_ FEE REQD: \_\_\_\_\_

# FIRE SAFETY INSPECTION RECORD

LICENSE

GENERAL  
PUBLIC ED  
PERMIT  
HIGH-RISE

LOCATION: *788 W Ridge Rd - Crown*

DATE RECEIVED IN FIRE SAFETY:

DATE

*6/10/96*

APPOINTMENT

PERSON CONTACTED

NO ENTRY

ORDERS ISSUED

REFERRALS ISSUED

NO WORK DONE

SOME WORK DONE

OTHER

OK TO FILE

INSPECTOR

*OUT OF BUSINESS  
MOVED OUT OF THE  
CITY LIMITS*

*JP*

**NEW  
INFORMATION**



V-822

# NOTICE OF VIOLATIONS

DATE 6-14-88

C.P. Ward Inc  
Name

788 Ridge Rd W  
Address

Inspection of premises located at same reveals violations of the Fire Prevention Code. Orders are hereby issued for correction of hazards listed herewith on or before: 6-24-88

Failure to comply with these orders may result in issuance of Municipal Code Violation Ticket with following penalties:

	INITIAL	FAILURE TO RESPOND
1st OFFENSE	\$ 50	\$100
2nd OFFENSE	\$100	\$200
3rd & SUBSEQUENT	\$250	\$500

Bob Young - 621-5450

9714c R02

1243.3 (1) Ground around waste oil tank shall be cleaned up.

(2) Excess oil on top of drums shall be cleaned up.

(3) Ground area around drum storage shall be cleaned.

1164.3 (4) Check for leak on regular gas pump and repair

(5) Diesel pump shall be anchor down.

(6) Hoses on regular & diesel pump shall be installed to keep off ground.

1162.3 (7) Exit signs shall be installed in main office addition

By Order of  
FIRE MARSHAL

INSPECTOR

Anthony Gallis 6519

DATE of COMPLIANCE

7-15-88

Inspector

A. Gallis







# City of Rochester FIRE DEPARTMENT

FIRE SAFETY DIVISION

300 Public Safety Building  
Rochester, New York 14614  
(716) 428-7037

## PERMIT

DATE 09/26/97

For keeping, storing, using, installing, manufacturing, handling, transporting, or otherwise employing flammable, combustible, or explosive materials, or materials, processes, or equipment, which if improperly used may produce conditions hazardous to life or property.

TO WHOM IT MAY CONCERN:

By virtue of the provisions of the Fire Prevention Code of the City of Rochester, NY.,

WARD, C P INC  
788 RIDGE

RD W

98-08079

PERMIT  
NUMBER

having made application in due form, and as the conditions, surroundings, and arrangements are, in my opinion, such that the intent of the Fire Prevention Code can be observed, authority is hereby given and this PERMIT is GRANTED for:

PERMIT CODE	PERMIT CATEGORY	FEE
5412B08	DUST PRODUCING OPERATION	\$ 80
5412B10A	FLAMMABLE LQD STORAGE - CLS I	\$ 50
5412B10B	COMBUSTIBLE LQD STORAGE - CLS II, III	\$ 50
5412B18	ACETYLENE/FLAMMABLE GAS USAGE	\$ 50
5412B24	PRIVATE PLANT	\$ 65
<b>TOTAL</b>		<b>\$ 295</b>

This PERMIT is issued and accepted on condition that all Fire Prevention Code provisions now adopted, or that may hereafter be adopted, shall be complied with, and said PERMIT will become valid only after receipt of total fee payment.

THIS PERMIT EXPIRES

08/31/98

This permit does not take the place of any  
License required by law and is not transfer-  
able. Any change in the use or occupancy  
of premises shall require a new permit.

FIRE MARSHAL

TREASURER CLERK

NOV24/97 01:39PM

C CLERK 02

1 FIRE PVN	295.00
SUBTOTAL	295.00
TOTAL	295.00
CHECK	295.00
# ITEM	1

5207 02 0101 NOV24/97 01:39P

1004 100  
Scotchville Rd. 14546

Permit fee payments not received by the due date will be considered delinquent.

These delinquent properties operating with invalid permits will be subject to the issuance of a Municipal Code Violations Summons pursuant to Chapter 54-10 of the Municipal Code.

Municipal Code Summons Schedule

	Initial	Default
1st Offense, or after 30 days	\$ 75.00	\$150.00
2nd Offense, or after 60 days	\$150.00	\$300.00
3rd Offense, or after 90 days	\$375.00	\$750.00



# City of Rochester

FIRE SAFETY DIVISION

FOR INTERNAL USE ONLY

DATE: 8/1/77 Page 1 of 1  
BUSINESS NAME: Central Book OWNER: JMC  
MAILING ADDRESS: \_\_\_\_\_ Zip \_\_\_\_\_ ADDRESS: 222 E. 1st St Zip \_\_\_\_\_  
ADDRESS OF VIOLATIONS: 222 E. 1st St CITY: Rochester  
ATTENTION: \_\_\_\_\_ REINSPECTION DATE: 8/1/77

CODE VIOLATION #	DESCRIPTION AND/OR LOCATION OF VIOLATION
<u>117.10</u>	<u>Fire safety division will issue not be used. A summary of the inspection</u>
	<u>we inspected the premises and the following</u>
	<u>violations were observed:</u>
	<u>1. Fire alarm system not working</u>
	<u>2. Fire extinguishers not inspected</u>
	<u>3. Fire escape not inspected</u>
	<u>4. Fire exit not inspected</u>
	<u>5. Fire door not inspected</u>
	<u>6. Fire hose not inspected</u>
	<u>7. Fire alarm control panel not inspected</u>
	<u>8. Fire alarm control panel not inspected</u>
	<u>9. Fire alarm control panel not inspected</u>
	<u>10. Fire alarm control panel not inspected</u>
	<u>11. Fire alarm control panel not inspected</u>
	<u>12. Fire alarm control panel not inspected</u>
	<u>13. Fire alarm control panel not inspected</u>
	<u>14. Fire alarm control panel not inspected</u>
	<u>15. Fire alarm control panel not inspected</u>
	<u>16. Fire alarm control panel not inspected</u>
	<u>17. Fire alarm control panel not inspected</u>
	<u>18. Fire alarm control panel not inspected</u>
	<u>19. Fire alarm control panel not inspected</u>
	<u>20. Fire alarm control panel not inspected</u>

INSPECTOR: John M. Parente IBM# 6692



City of Rochester  
FIRE SAFETY DIVISION  
FOR INTERNAL USE ONLY

5-91

DATE: 7-1-97 Page 1 of 1  
 BUSINESS NAME: CPWARD INC. OWNER: CPWARD INC.  
 MAILING ADDRESS: \_\_\_\_\_ Zip \_\_\_\_\_ ADDRESS: 800 W Ridge Rd Zip 14615  
 ADDRESS OF VIOLATIONS: 800 Ridge Rd. CITY: Roch NY  
 ATTENTION: \_\_\_\_\_ REINSPECTION DATE: 8/8/97

CODE VIOLATION #	DESCRIPTION AND/OR LOCATION OF VIOLATION
1191.1A	THE FUEL TANK TRUCK SHALL BE PROPERLY REGISTERED AND INSPECTED BY THE FIRE SAFETY DIVISION AND SHALL NOT BE USED A STATIONARY FUELING OPERATION.
1175.1D	THE COMPRESSED GAS CYLINDERS IN THE WELDING SHOP SHALL BE SECURED
1194.1a	THE PROPANE STORAGE AREA SHALL HAVE FIRE SAFETY STORAGE (NO SMOKING DANGER FLAMMABLE GAS)
1191.1A	THE PRODUCT REMOVED FROM THE UNDERGROUND FUEL TANKS SHALL BE REMOVED FROM THE AREA BY A QUALIFIED ENVIRONMENTAL COMPANY

INSPECTOR: John M. Parente IBM# 6692

275 gallon propane



300 Public Safety Building  
Rochester, New York 14614  
716-428-7037  
716-428-6069 FAX

C.P. Ward  
800 W. Ridge Road  
Rochester, New York 14615

July 21, 1997

PLEASE TAKE NOTICE that an inspection on July 1, 1997, at 800 W. Ridge Road, revealed violation(s) of the Fire Prevention Code of the City of Rochester and/or the Codes, Rules and Regulations of the State of New York.

Orders are hereby issued for violation(s) to be corrected before or on August 8, 1997. Failure to comply with these orders will result in the issuance of a Municipal Code Violation summons for each uncorrected violation with the following penalties:

	INITIAL	FAILURE TO RESPOND
1ST OFFENSE	\$ 75.00	\$150.00
2ND OFFENSE	150.00	300.00
3RD OFFENSE	375.00	750.00

During this period, the property owner continues to be responsible and liable for any damages arising from the violation(s).

Relevant section(s) of the New York State Uniform Fire Prevention and Building Code (Title 9NYCRR) wit:

1175.1(d) Compressed gas cylinders in storage or in service shall be secured to prevent falling or being upset and shall be protected against tampering by unauthorized persons.  
THE COMPRESSED GAS CYLINDERS IN THE WELDING SHOP SHALL BE SECURED. ✓

1191.1(a) Precautions shall be taken to protect property and premises against the starting and spreading of fires. <CI-244>

1-THE FUEL TANK TRUCK SHALL BE NYS REGISTERED AND INSPECTED BY THE FIRE SAFETY DIVISION AND SHALL NOT BE USED AS A STATIONARY FUELING OPERATION. ✓

2-THE PRODUCT REMOVED FROM THE UNDERGROUND FUEL TANKS SHAOUL BE REMOVED FROM THE AREA BY A QUALIFIED ENVIRONMENTAL COMPANY. *Some*

1194.1(a) Fire safety signs include, among others: occupancy signs, limiting the maximum number of occupants permitted in public areas; no smoking signs, prohibiting smoking in areas

where conditions exist which make smoking a fire hazard; danger signs, alerting persons to areas where special danger of fire or explosion exists; elevator warning signs, instructing occupants to use exit stairs in case of fire; and incinerator warning signs, prohibiting the disposal of lighted, flammable, combustible or explosive materials in the incinerator.

THE PROPANE STORAGE AREA SHALL HAVE FIRE SAFETY SIGNAGE (NO SMOKING ✓  
DANGER FLAMMABLE GAS).

ORDER OF THE FIRE MARSHAL

COMPLIANCE 913197

INSPECTOR

*John Parente*  
\_\_\_\_\_  
JOHN PARENTE 6692  
*John Parente*  
\_\_\_\_\_

INSPECTOR





# FIRE SAFETY INSPECTION RECORD

LOCATION:

788 RIDGE RD W  
UNITED RENTALS

Person contacted:

- LICENSE
- PERMIT
- COMPLAINT
- EAST
- WEST
- SPECIAL REFERRAL

DATE RECEIVED IN FIRE SAFETY:	TIME OF INSPECTION	NO ENTRY	# ORDERS ISSUED	# REFERRALS ISSUED	NO WORK DONE	# VIOLATIONS CORRECTED	NO VIOLATIONS NOTED	Telephone #:	Owner Name:	Owner Address:	Owner Phone:	OK TO FILE	INSPECTOR
DATE								NOTES					
5/2/06												X	EF

	Y	N
Sprinkler System	X	
Alarm Permit	X	
Cooking Hood		X
Fire Alarm System	X	
Standpipe System		X
Cooking System		X
Bars/Wires on Windows		X
Lock Box		X
Posted Occupancy		

Permit# 24498 4/30/07

Local Central (circle one)

**APPROVED**  
**FIRE SAFETY DIVISION**  
*Ed Ferretti*  
\_\_\_\_\_  
Fire Marshal



**City of Rochester  
FIRE DEPARTMENT**

FIRE SAFETY DIVISION

300 Public Safety Building  
Rochester, New York 14614  
(716) 428-7037

**PERMIT**

DATE 09/10/96

For keeping, storing, using, installing, manufacturing, handling, transporting, or otherwise employing flammable, combustible, or explosive materials, or materials, processes, or equipment, which if improperly used may produce conditions hazardous to life or property.

TO WHOM IT MAY CONCERN:

By virtue of the provisions of the Fire Prevention Code of the City of Rochester, NY.,

WARD, C P INC  
788 RIDGE

RD W

97-08084	PERMIT NUMBER
----------	---------------

having made application in due form, and as the conditions, surroundings, and arrangements are, in my opinion, such that the intent of the Fire Prevention Code can be observed, authority is hereby given and this PERMIT is GRANTED for:

PERMIT CODE	PERMIT CATEGORY	FEE
5412B08	DUST PRODUCING OPERATION	\$ 80
5412B10A	FLAMMABLE LQD STORAGE - CLS I	\$ 50
5412B10B	CMBSTBLE LQD STORAGE - CLS II,III	\$ 50
5412B18	ACETYLENE/FLAMMABLE GAS USAGE	\$ 50
5412B24	PRIVATE PLANT	\$ 145
<b>TOTAL \$</b>		<b>375</b>

This PERMIT is issued and accepted on condition that all Fire Prevention Code provisions now adopted, or that may hereafter be adopted, shall be complied with, and said PERMIT will become valid only after receipt of total fee payment.

THIS PERMIT EXPIRES

08/31/97

This permit does not take the place of any License required by law and is not transfer-

RECEIVED  
 08/21/96 11:30AM

U ULENK U2  
 1 FINE FOR 3/5.00  
 SUBTOTAL 3/5.00  
 TOTAL 3/5.00  
 CHECK 3/5.00  
 # ITEM 1

08/21/96 11:30AM

Permit fee payments not received by the due date will be considered delinquent.

These delinquent properties operating with invalid permits will be subject to the issuance of a Municipal Code Violations Summons pursuant to Chapter 54-10 of the Municipal Code.

Municipal Code Summons Schedule

	Initial	Default
1st Offense, or after 30 days	\$ 75.00	\$150.00
2nd Offense, or after 60 days	\$150.00	\$300.00
3rd Offense, or after 90 days	\$375.00	\$750.00



# Range Hood Systems Report

FRYER

**Rochester Fire**  
EQUIPMENT CO., INC.

64 MARSHALL ST.  
ROCHESTER, NY 14607  
(585) 546-6765 • FAX (585) 546-6849

Name: W. Daniels Rpt  
Address: 1410 1st St  
City: Rochester, N.Y.  
Telephone: \_\_\_\_\_ Store No. \_\_\_\_\_  
Owner or Manager: \_\_\_\_\_

COOKING APPLIANCE LOCATIONS: LEFT TO RIGHT

FRYER (215)	FRYER (215)
FRYER (215)	

DATE OF SERVICE <u>5-26-05</u>	TIME <u>6:00</u>	A.M. <input checked="" type="checkbox"/>	P.M. <input type="checkbox"/>
ANNUAL <input checked="" type="checkbox"/>	SEMI-ANNUAL <input type="checkbox"/>	RECHARGE <input type="checkbox"/>	INSTALLATION <input type="checkbox"/>
LOCATION OF SYSTEM CYLINDERS <u>Sub hood on wall</u>			
MANUFACTURER <u>W. Daniels</u>	MODEL NUMBER <u>R-102</u>	WET <input checked="" type="checkbox"/>	ALARM CONNECTION <input checked="" type="checkbox"/> YES <input type="checkbox"/> NO
CYLINDER SIZE MASTER <u>2.001</u>	CYLINDER SIZE SLAVE <u>M12</u>	CYLINDER SIZE SLAVE <u>M12</u>	
FUSE LINKS 360° F	FUSE LINKS 450° F	FUSE LINKS 500° F	OTHER
FUEL SHUT-OFF	ELECTRIC <input checked="" type="checkbox"/>	GAS <input type="checkbox"/>	SIZE
SERIAL NUMBER	LAST HYDRO TEST DATE <u>1999</u>	LAST RECHARGE DATE	
EXHAUST DUCT OPENINGS QTY: _____ SIZE: <u>10 1/8</u>		EXHAUST HOOD LENGTH	
DUCT NOZZLES & TYPE: <u>1-30</u>		PLENUM NOZZLES & TYPE: <u>1-12</u>	

- All appliances properly covered w/correct nozzles
- Duct and plenum covered w/correct nozzles
- Check positioning of all nozzles
- System installed in accordance w/MFG UL listing
- Hood/duct penetrations sealed w/weld or UL device
- Check if seals intact, evidence of tampering
- If system has been discharged, report same
- Pressure gauge in proper range (if gauged)
- Check cartridge weight (if applicable)
- Hydrostatic test date
- Inspect cylinder and mount
- Operate system from terminal detector with test link
- Test for proper operation from remote
- Check operation of micro switch
- Check operation of gas valve
- Clean nozzles
- Proper nozzle covers in place
- Reset electric relay switch for solenoid gas valve
- Replaced fuse links
- Check travel of cable nuts/S-hooks

- Piping & conduit securely bracketed
  - Proper separation between fryers & flame
  - Proper clearance-flame-to-filters
  - Exhaust fan in operating order
  - Is make up air shutdown present
  - Fuel shut-off in on position
  - Manual & remote set/seals in place
  - Replace systems covers
  - System operational & seals in place
  - Slave system operational
  - Clean cylinder & mount
  - Fan warning sign on hood
  - Personnel instructed in manual operation of system
  - Is system tied into bldg. fire alarm
  - K-class fire extinguisher & proper signage
  - Service & Certification tag on system
- NOTE DISCREPANCIES OR DEFICIENCIES BELOW
- System U/L 300 Compliant YES  NO
  - System flushed & recharged if applicable
  - Name town of authority having jurisdiction COPE
  - Does system meet NFPA 17A standards

COMMENTS: \_\_\_\_\_

On this date, the above system was tested and inspected in accordance with procedures of the presently adopted editions of NFPA 17, 17A, 96 and the manufacturer's manual and was operated according to these procedures with results indicated above.

X John White / Ken ... SERVICE TECHNICIAN DATE: 5/26/05 TIME: 6:00 AM PM CUSTOMERS AUTHORIZED AGENT W. Daniels

The above service technician certifies that the system was personally inspected and found conditions to be as indicated on this report.

OFFICE COPY

# Range Hood Systems Report

## Rochester Fire

**EQUIPMENT CO., INC.**

64 MARSHALL ST.  
ROCHESTER, NY 14607  
(585) 546-6765 • FAX (585) 546-6849

DATE OF SERVICE <i>5/2/05</i>		TIME <i>5:00</i>		A.M.	P.M.
ANNUAL	SEMI-ANNUAL	RECHARGE	INSTALLATION	RENOVATION	
LOCATION OF SYSTEM CYLINDERS <i>Exhaust on hood</i>					
MANUFACTURER <i>Wes</i>	MODEL NUMBER <i>R-100</i>	WET	ALARM CONNECTION <input checked="" type="checkbox"/> YES <input type="checkbox"/> NO		
CYLINDER SIZE MASTER <i>N/A</i>	CYLINDER SIZE SLAVE <i>N/A</i>	CYLINDER SIZE SLAVE <i>N/A</i>			
FUSE LINKS 360° F	FUSE LINKS 450° F	FUSE LINKS 500° F	OTHER		
FUEL SHUT-OFF	ELECTRIC	GAS	SIZE <i>1 1/2"</i>		
SERIAL NUMBER	LAST HYDRO TEST DATE <i>1999</i>	LAST RECHARGE DATE			
EXHAUST DUCT OPENINGS QTY: <i>1</i> SIZE: <i>2 1/2"</i>			EXHAUST HOOD LENGTH <i>37 1/2"</i>		
DUCT NOZZLES & TYPE: <i>1 - 2 1/2"</i>			PLENUM NOZZLES & TYPE: <i>3 1/2"</i>		

Name *McQuarrie, Rust*  
Address *1410 E. 24th St*  
City *Rochester NY 14606*  
Telephone \_\_\_\_\_ Store No. \_\_\_\_\_

Owner or Manager \_\_\_\_\_

COOKING APPLIANCE LOCATIONS: LEFT TO RIGHT

<i>Fryer (245)</i>	<i>Fryer (245)</i>

1. All appliances properly covered w/correct nozzles
2. Duct and plenum covered w/correct nozzles
3. Check positioning of all nozzles
4. System installed in accordance w/MFG UL listing
5. Hood/duct penetrations sealed w/weld or UL device
6. Check if seals intact, evidence of tampering
7. If system has been discharged, report same
8. Pressure gauge in proper range (If gauged)
9. Check cartridge weight (If applicable)
10. Hydrostatic test date
11. Inspect cylinder and mount
12. Operate system from terminal detector with test link
13. Test for proper operation from remote
14. Check operation of micro switch
15. Check operation of gas valve
16. Clean nozzles
17. Proper nozzle covers in place
18. Reset electric relay switch for solenoid gas valve
19. Replaced fuse links
20. Check travel of cable nuts/S-hooks

COMMENTS: \_\_\_\_\_

21. Piping & conduit securely bracketed
  22. Proper separation between fryers & flame
  23. Proper clearance-flame to filters
  24. Exhaust fan in operating order
  25. Is make up air shutdown present
  26. Fuel shut-off in on position
  27. Manual & remote set/seals in place
  28. Replace systems covers
  29. System operational & seals in place
  30. Slave system operational
  31. Clean cylinder & mount
  32. Fan warning sign on hood
  33. Personnel instructed in manual operation of system
  34. Is system tied into bldg. fire alarm
  35. K-class fire extinguisher & proper signage
  36. Service & Certification tag on system
- NOTE DISCREPANCIES OR DEFICIENCIES BELOW
37. System U/L 300 Compliant YES  NO
  38. System flushed & recharged if applicable
  39. Name town of authority having jurisdiction *W. Rochester*
  40. Does system meet NFPA17A standards

On this date, the above system was tested and inspected in accordance with procedures of the presently adopted editions of NFPA 17, 17A, 96 and the manufacturer's manual and was operated according to these procedures with results indicated above.

<i>Jim Cook</i>	DATE: <i>5/2/05</i>	TIME: <i>5:00</i>	AM	PM	CUSTOMERS AUTHORIZED AGENT <i>John ...</i>
-----------------	---------------------	-------------------	----	----	---

The above service technician certifies that the system was personally inspected and found conditions to be as indicated on this report.

OFFICE COPY

# Range Hood Systems Report

## Rochester Fire

**EQUIPMENT CO., INC.**

64 MARSHALL ST.  
 ROCHESTER, NY 14607  
 (585) 546-6765 • FAX (585) 546-6849

Name W.D. Smith, Sr.

Address 140 2nd St. W. Rochester, NY

City Rochester, NY 14607

Telephone \_\_\_\_\_ Store No. \_\_\_\_\_

Owner or Manager \_\_\_\_\_

COOKING APPLIANCE LOCATIONS: LEFT TO RIGHT

<u>Grill (200)</u>	<u>Grill (200)</u>
--------------------	--------------------

DATE OF SERVICE <u>5-20-05</u>		TIME <u>5:30</u>		A.M.	P.M.
ANNUAL	SEMI-ANNUAL	RECHARGE	INSTALLATION	RENOVATION	
LOCATION OF SYSTEM CYLINDERS: <u>40' 2nd St. W. of 2nd St.</u>					
MANUFACTURER <u>MFG</u>	MODEL NUMBER <u>1-102</u>	WET		ALARM CONNECTION <input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	
CYLINDER SIZE MASTER <u>3' x 1'</u>	CYLINDER SIZE SLAVE <u>1 1/2'</u>	CYLINDER SIZE SLAVE <u>4' x 2'</u>			
FUSE LINKS 360' F	FUSE LINKS 450' F	FUSE LINKS 500' F	OTHER		
FUEL SHUT-OFF	ELECTRIC	GAS	SIZE		
SERIAL NUMBER	LAST HYDRO TEST DATE <u>1999</u>	LAST RECHARGE DATE			
EXHAUST DUCT OPENINGS QTY: <u>1</u> SIZE: <u>10" x 10"</u>			EXHAUST HOOD LENGTH <u>7' 6"</u>		
DUCT NOZZLES & TYPE: <u>1-2L</u>			PLENUM NOZZLES & TYPE: <u>1-2L</u>		

1. All appliances properly covered w/correct nozzles
2. Duct and plenum covered w/correct nozzles
3. Check positioning of all nozzles
4. System installed in accordance w/MFG UL listing
5. Hood/duct penetrations sealed w/weld or UL device
6. Check if seals intact, evidence of tampering
7. If system has been discharged, report same
8. Pressure gauge in proper range (If gauged)
9. Check cartridge weight (If applicable)
10. Hydrostatic test date 1999
11. Inspect cylinder and mount
12. Operate system from terminal detector with test link
13. Test for proper operation from remote
14. Check operation of micro switch
15. Check operation of gas valve
16. Clean nozzles
17. Proper nozzle covers in place
18. Reset electric relay switch for solenoid gas valve
19. Replaced fuse links
20. Check travel of cable nuts/S-hooks

21. Piping & conduit securely bracketed
  22. Proper separation between fryers & flame
  23. Proper clearance-flame to filters
  24. Exhaust fan in operating order
  25. Is make up air shutdown present
  26. Fuel shut-off in on position
  27. Manual & remote set/seals in place
  28. Replace systems covers
  29. System operational & seals in place
  30. Slave system operational
  31. Clean cylinder & mount
  32. Fan warning sign on hood
  33. Personnel instructed in manual operation of system
  34. Is system tied into bldg. fire alarm
  35. K-class fire extinguisher & proper signage
  36. Service & Certification tag on system
- NOTE DISCREPANCIES OR DEFICIENCIES BELOW
37. System U/L 300 Compliant YES  NO
  38. System flushed & recharged if applicable
  39. Name town of authority having jurisdiction W. NY
  40. Does system meet NFPA17A standards

COMMENTS: \_\_\_\_\_

On this date, the above system was tested and inspected in accordance with procedures of the presently adopted editions of NFPA 17, 17A, 96 and the manufacturer's manual and was operated according to these procedures with results indicated above.

X <u>Jim Childs / Kevin Adams</u> SERVICE TECHNICIAN	DATE: <u>5/20/05</u>	TIME: <u>5:30</u>	AM <input type="checkbox"/> PM <input checked="" type="checkbox"/>	CUSTOMERS AUTHORIZED AGENT <u>W.D. Smith, Sr.</u>
---	----------------------	-------------------	--	--

The above service technician certifies that the system was personally inspected and found conditions to be as indicated on this report.

OFFICE COPY





City of Rochester  
FIRE SAFETY DIVISION  
FOR INTERNAL USE ONLY

4-425

DATE: 9/17/96 Page 1 of 2  
 BUSINESS NAME: C.P. WARD Inc OWNER: \_\_\_\_\_  
 MAILING ADDRESS: 800 RIDGE RD W Zip 15 ADDRESS: \_\_\_\_\_ Zip \_\_\_\_\_  
 ADDRESS OF VIOLATIONS: 788 RIDGE RD W CITY: \_\_\_\_\_  
 ATTENTION: BILL KHELL - Roy REINSPECTION DATE: 10/8/96  
889-8800

CODE VIOLATION #	DESCRIPTION AND/OR LOCATION OF VIOLATION
1171.3B3(iii)-	THE FLAMM IN THE SHOP SHALL BE KEPT IN THE METAL LOCKERS WHEN NOT IN USE
1171.1D	THE FLAMM LIQUID CAN USED FOR DISPENSING (WINDSHIELD FLUID) SHALL BE GROUNDED HAVE A BONDING CABLE FOR THE CONTAINERS BEING DISPENSED INTO
1164.3A1 1164.3A2	THE DIESEL FUEL TRUCK & FUEL PUMP SET UP FOR DISPENSING SHALL BE REMOVED
1175.1B 1175.1D	THE LOOSE ACETYLENE & THE LPG TANKS AT THE NORTH REAR EXIT SHALL BE MOVED TO THE LPG STORAGE AREA

For

INSPECTOR: ED Cerrante IBM# 6610



City of Rochester  
Fire Department  
Office of the Fire Marshal

300 Public Safety Building  
Rochester, New York 14614  
716-428-7037  
716-428-6069 FAX

## NOTICE OF VIOLATIONS

Bill Kheil *OR MATT KOEHLER*  
C P. Ward Inc.  
800 Ridge Rd W.  
Rochester, New York 14615

September 18, 1996

PLEASE TAKE NOTICE that an inspection on September 17, 1996, at 788 Ridge Rd. W., revealed violation(s) of the Fire Prevention Code of the City of Rochester and/or the Codes, Rules and Regulations of the State of New York.

Orders are hereby issued for violation(s) to be corrected before or on October 8, 1996. Failure to comply with these orders will result in the issuance of a Municipal Code Violation summons for each uncorrected violation with the following penalties:

	INITIAL	FAILURE TO RESPOND
1ST OFFENSE	\$ 75.00	\$150.00
2ND OFFENSE	150.00	300.00
3RD OFFENSE	375.00	750.00

During this period, the property owner continues to be responsible and liable for any damages arising from the violation(s).

Relevant section(s) of the New York State Uniform Fire Prevention and Building Code (Title 9NYCRR) to wit:

1171.1(d) Containers having a capacity of 10 gallons or more, and equipment used for flammable liquids, shall be electrically bonded or grounded during transfer of liquids.  
**THE FLAMMABLE LIQUID CAN USED FOR DISPENSING (WINDSHIELD FLUID) SHALL BE GROUNDED , HAVING A BONDING CABLE FOR THE CONTAINERS BEING DISPENSED INTO.**

1171.3(b)(3)(iii) C1 OCCUPANCIES. Storage shall be prohibited except that which is required for maintenance and operation of building and operation of equipment. Such storage shall be kept in closed metal containers stored in a storage cabinet or in safety cans or in an inside storage room not having a door that opens into that portion of the building used by the public.  
**THE FLAMMABLE IN THE SHOP SHALL BE KEPT IN THE METAL LOCKERS WHEN NOT IN USE.**

1175.1(b) Compressed gases shall be manufactured, stored, handled and used in accordance with reference standards RS-48-1 through RS-48-9. [AMENDED EFFECTIVE JULY 26, 1995]

1175.1(d) Compressed gas cylinders in storage or in service shall be secured to prevent falling or being upset and shall be protected against tampering by unauthorized persons.  
**THE LOOSE ACETYLENE AND THE LPG TANKS AT THE NORTH REAR EXIT SHALL BE MOVED TO THE LPG STORAGE AREA.**

1164.3(a)(1) Equipment, piping, tanks electrical systems and dispensers shall be maintained according to reference standards RS-45-1, RS-45-2 and RS-47-2. [AMENDED EFFECTIVE JULY 26, 1995]

1164.3(a)(2) All existing equipment, piping, tanks, electrical systems, and dispensers shall be in compliance with the requirements specified in paragraph 1164.3(a)(1) of this subdivision except they may be permitted to continue in use if they do not constitute a distinct hazard to life or property.

THE DIESEL FUEL TRUCK AND FUEL PUMP SET UP FOR DISPENSING SHALL BE REMOVED. ✓

1163.11(g) Exposed wiring shall be protected against physical damage in conformity with reference standard RS-51-2. [AMENDED EFFECTIVE JULY 26, 1995]

THE MISSING BLANKS IN THE PANEL BOX IN THE FILTER STORAGE ROOM SHALL BE REPLACED. ✓

1194.1(a) Fire safety signs include, among others: occupancy signs, limiting the maximum number of occupants permitted in public areas; no smoking signs, prohibiting smoking in areas where conditions exist which make smoking a fire hazard; danger signs, alerting persons to areas where special danger of fire or explosion exists; elevator warning signs, instructing occupants to use exit stairs in case of fire; and incinerator warning signs, prohibiting the disposal of lighted, flammable, combustible or explosive materials in the incinerator.

1194.1(b) Fire safety signs shall be posted on premises as specified in subdivision 1194.1(a) of this section.

THE LPG STORAGE AREA SHALL HAVE "LPG" SIGNS POSTED SHOWING ITS LOCATION/ ✓

BY ORDER OF THE FIRE MARSHAL INSPECTOR EA  
EDWARD FERRANTE 6610

DATE OF COMPLAINE 2/4/97 INSPECTOR Ed Ferrante

FIRE SAFETY INSPECTION RECORD

LICENSE

WEST

GENERAL  
PUBLIC ED  
PERMIT  
HIGH-RISE

LOCATION: **788 RIDGE RD W**

DATE RECEIVED IN FIRE SAFETY:  
**10-1-96**  
DATE

APPOINTMENT	PERSON CONTACTED	NO ENTRY	ORDERS ISSUED	REFERRALS ISSUED	NO WORK DONE	SOME WORK DONE	OTHER	OK TO FILE	INSPECTOR
							<b>SEE ATTACHED</b>		

**3-13-97**

*RE-INSPECT*

*4110 4000's 3000's  
OFFICE BEING TORN DOWN  
IN A MATTER OF DAYS  
UNOCCUPIED AT THIS TIME*

*JP*

**3-17-97**

*BLDG DEMOLISHED  
WHERE 1ST VIOLATION  
WAS CITED*

*JP*

**FILE**

BUILDING INSPECTION / COMPLAINT FORM



009390

COMPANY E10

ADDRESS RIDGE RD W

PROPERTY OWNER C P WARD INC

MAILING NAME C P WARD INC

EMERGENCY CONTACT BILL KEIHL

FROM / TO 788

INSPECTION # TAX ACCT # 018888-00.0  
ADDRESS 800 W RIDGE RD PHONE 621-5450  
CITY ROCHESTER STATE NY ZIP 14615  
ADDRESS 800 W RIDGE RD PHONE  
CITY ROCHESTER STATE NY ZIP 14615  
ADDRESS 563 NORTH RD PHONE 889-9362  
CITY SCOTTSVILLE STATE NY ZIP 14546

NFPA 901 CODES GENERAL PROPERTY USE 80 SPECIFIC PROPERTY USE 891 STRUCTURE TYPE 2 STRUCTURE STATUS 2

NO ENTRY DATES:

BUSINESS NAME ~~VALLEY SAND & GRAVEL~~ PHONE  
BUSINESS OWNER C P WARD CORP  
ADDRESS 788 W. RIDGE RD ROCHESTER NY14615  
PHONE  
BUSINESS EMERGENCY RICHARD ASH 721 3102  
ADDRESS 2626 RIVER RD PITTSFORD NY14553  
PHONE 224 3190

DISPOSITION by FIRE SAFETY:

- A = ATTIC
- C = CELLAR
- G = GARAGE
- O = OUTSIDE
- # = FLOOR #

SPECIAL INSTRUCTIONS:

SPECIAL HAZARDS OR CONSTRUCTION

COMPLAINT

DIRECTION ROOM #, ETC.	COMPLAINT	REFERRED	ORDERS ISSUED	CORRECTED	NOT REQUIRED
Office	Heater flue needs spoking at exhaust			X	
Yard	General Combustible Clutter (trees etc)			X X	
Yard (west)	Propane storage area needs to be clearly marked. (Done)			X X	
Garage	Flammable liquids not stored properly → Not Done			X X	
	Receipt. on 9/9				
	LT. T. Speck				

OFFICER PREPARING REPORT: Capt. J. L. Stone  
 BUS/PROP REPRESENTATIVE: Mr. Cook  
 FIRE SAFETY INSPECTOR: DAN M. PARENTE  
 COMPANY: E10 DISTRICT: E-10 GROUP: 3 DATE: 6-17-96  
 POSITION / TITLE: Employee DATE: 6-17-96  
 DATE: 3-13-97

INSPECTION DATE: \_\_\_\_\_

LOCATION: 788 RIDGE RD W 01 OWNER: UNITED RENTALS  
788 W RIDGE RD  
ROCHESTER MY 14615

OCCUPANT: \_\_\_\_\_ TYPE OF OPERATION: \_\_\_\_\_

PERSON CONTACTED: BOB BROWN PHONE NO: 6217318 APPOINTMENT: (Y/N) \_\_\_\_\_

(CONDITIONS, SURROUNDINGS AND ARRANGEMENTS FOUND:

CODE	FEE	PERMIT
5412B10C	70	06138 FLAM/COMB LQD CLS I,II,III
5412B12A	150	FLAM/CMPRESS GAS-OVER 2000 CU FT
5412B18	70	ACETYLENE/FLAMMABLE GAS USAGE
5412B23A	70	PRIVATE PLANT
5412B23B	<del>40</del> 20	PRIVATE PLANT DISPENSING UNITS (2)

DATE VIOLATIONS ISSUED: \_\_\_\_\_ 20 \_\_\_\_\_ CORRECTED: \_\_\_\_\_ 20 \_\_\_\_\_

DATE OF APPROVAL FOR PERMIT: \_\_\_\_\_ 20 \_\_\_\_\_ SIGNATURE: \_\_\_\_\_

----- FOR OFFICE USE ONLY -----

DATE PERMIT ISSUED: \_\_\_\_\_ 20 \_\_\_\_\_ DATE EXPIRED: \_\_\_\_\_ 20 \_\_\_\_\_

PERMIT NUMBER: \_\_\_\_\_ FEE REQD: \_\_\_\_\_

**FIRE SAFETY INSPECTION RECORD**

- LICENSE
- PERMIT
- COMPLAINT
- EAST
- WEST
- SPECIAL

*Saw*

**LOCATION:**

788 RIDGE RD W  
UNITED RENTALS

**Person contacted:**

DATE RECEIVED IN FIRE SAFETY:  <i>4-25-05</i>	TIME OF INSPECTION	NO ENTRY	# ORDERS ISSUED	# REFERRALS ISSUED	NO WORK DONE	# VIOLATIONS CORRECTED	NO VIOLATIONS NOTED	Telephone #:  Owner Name: _____ Owner Address: _____ Owner Phone: _____	OK TO FILE	INSPECTOR
---	--------------------	----------	-----------------	--------------------	--------------	------------------------	---------------------	---	------------	-----------

DATE	TIME OF INSPECTION	NO ENTRY	# ORDERS ISSUED	# REFERRALS ISSUED	NO WORK DONE	# VIOLATIONS CORRECTED	NO VIOLATIONS NOTED	NOTES	OK TO FILE	INSPECTOR
<i>6/1/05</i>										<i>No</i>
<i>6-15-05</i>										<i>No</i>

	Y	N
Sprinkler System		
Alarm Permit		
Cooking Hood		
Fire Alarm System		
Standpipe System		
Cooking System		
Bars/Wires on Windows		
Lock Box		

Permit# \_\_\_\_\_

Local    Central    (circle one)

**APPROVED  
FIRE SAFETY DIVISION**

\_\_\_\_\_  
Fire Marshal

# SOLUTIONEIT

31 Firestone Dr., Rochester, NY 14624 - (585) 247-3480

## Fire Protection Systems

# INSPECTION AND TEST REPORT

Att: Sam Alicata

5/31/05

3 pgs

NAME United Rentals		DATE 5/5/05	SERIAL NO.			
ADDRESS 788 West Ridge Rd.		CONTROL PANEL TYPE FCI				
CITY Rochester	STATE NY	ZIP 14615	SYSTEM LOCATION Telephone Rm.			
Installation	Installation	Monthly	Quarterly	Semi-annual	<u>Annual</u>	Other
equipment	no. of devices	no. tested	comments:			
control	1	1				
annunciator	1	1				
heat detectors	8	8				
smoke detectors	3	3				
pull stations	5	5				
signal devices	5	5				
fan shutdown						
door holders						
trouble devices			remarks, parts used, additions or modifications, etc.			
remote stations						
dampers						
batteries	2	2	13.7 vdc , 13.7 vdc			
charger	1	1				
abort stations						
EOP shutdown						
fire suppressant						
city connection						
Local fire dept. Rochester	official contacted Ronnie	test received N/A	reset	AM	PM	

### Limitation of Liability

The Contractor makes NO WARRANTIES, EXPRESS, OR IMPLIED, INCLUDING, WITHOUT LIMITATION, WARRANTIES OF MERCHANTABILITY AND WARRANTIES OF FITNESS FOR A PARTICULAR PURPOSE. No promise not contained herein or affirmation of fact made by any employee, agent or representative of the Contractor shall constitute a warranty by the Seller or give rise to any liability or obligation.

Contractor's liability to Subscriber for personal injury, death, or property damage arising from performance under this contract shall be limited to the contract price. Subscriber shall hold Contractor harmless from any and all third party claims for personal injury, death or property damage, arising from Subscriber's failure to maintain these systems or keep them in operative condition, whether based upon contract, warranty, tort, strict liability or otherwise. In no event shall the Contractor be liable for any special, indirect, incidental, consequential or liquidated, penal or any economic loss damages of any character, including but not limited to loss of the use of the subscriber's property, lost profits or lost production, whether claimed by the Subscriber or by any third party, irrespective of whether claims or actions for such damages are based upon contract, warranty, negligence, tort, strict liability or otherwise.

U Alicata  
Customer Signature

R Alicata  
Signature

Monthly Inspection of Emergency Lights - 2005

- 1 - Above window in showroom
- 1 Emergency light in hallway to back
- 1 Emergency light above door to back
- 1 Above Blue door in shop area

Please insert actual date inspected & check off each light in column

Attn: Sam  
Alcanta  
5/31/05

Date Inspected	Hallway Light	Light Above Door to Shop	Window Showroom	Blue Door to Exit Shop
Jan-05	1/13	1/13	1/13	1/13
Notes				
05-Feb	2/11	2/11	2/11	2/11
Notes				
05-Mar	3/10	3/10	3/10	3/10
Notes				
05-Feb	4/12/05	4/12	4/12	4/12
Notes				
05-May	5/11	5/11	5/11	5/11
Notes				
05-Jun				
Notes				
05-Jul				
Notes				
05-Aug				
Notes				
05-Sep				
Notes				
05-Oct				
Notes				
05-Nov				
Notes				
05-Dec				
Notes				

United Rentals  
788 W Ridge Rd  
Rochester Ny  
14615  
585-621-7054

If there is anything not working properly - please note on this sheet & report to safety person

Monthly Inspection of Emergency Lights - 2004

- 1 - Above window in showroom
- 1 Emergency light in hallway to back
- 1 Emergency light above door to back
- 1 Above Blue door in shop area

Please insert actual date inspected & check off each light in column

Att: Sam  
ALICATA  
5/31/05

Date Inspected	Hallway Light	Light Above Door to Shop	Window Showroom	Blue Door to Exit Shop
Jan-03				
Notes	1/14/03	1/14/03	1/14/03	1/14/03
04-Feb	2/17/03	2/17/03	2/17/03	2/17/03
Notes				
04-Mar	3/16/03	3/16/03	3/16/03	3/16/03
Notes				
04-Apr	4/14/03	4/14/03	4/14/03	4/14/03
Notes				
04-May	5/12/03	5/12/03	5/12/03	5/12/03
Notes				
04-Jun	6/15/03	6/15/03	6/15/03	6/15/03
Notes				
04-Jul	7/14/03	7/14/03	7/14/03	7/14/03
Notes				
04-Aug	8/12/03	8/12/03	8/12/03	8/12/03
Notes				
04-Sep	9/14/03	9/14/03	9/14/03	9/14/03
Notes				
04-Oct	10/13/03	10/13/03	10/13/03	10/13/03
Notes				
04-Nov	11/12/03	11/12/03	11/12/03	11/12/03
Notes				
04-Dec	12/15/03	12/15/03	12/15/03	12/15/03
Notes				

United Rentals  
788 W Ridge Rd.  
Rochester NY  
14615  
585-621-7054

If there is anything not working properly - please note on this sheet & report to safety person



# City of Rochester FIRE DEPARTMENT

FIRE SAFETY DIVISION

300 Public Safety Building  
Rochester, New York 14614  
(716) 428-7037

DATE 08/07/95

## PERMIT

For keeping, storing, using, installing, manufacturing, handling, transporting, or otherwise employing flammable, combustible, or explosive materials, or materials, processes, or equipment, which if improperly used may produce conditions hazardous to life or property.

TO WHOM IT MAY CONCERN:

By virtue of the provisions of the Fire Prevention Code of the City of Rochester, NY,

WARD, C P INC  
788 RIDGE

RD W

96-08087

PERMIT  
NUMBER

having made application in due form, and as the conditions, surroundings, and arrangements are, in my opinion, such that the intent of the Fire Prevention Code can be observed, authority is hereby given and this PERMIT is GRANTED for:


PERMIT CODE	PERMIT CATEGORY	FEE
5412B08	DUST PRODUCING OPERATION	\$ 80
5412B10A	FLAMMABLE LQD STORAGE - CLS I	\$ 50
5412B10B	CMBSTBLE LQD STORAGE - CLS II,III	\$ 50
5412B18	ACETYLENE/FLAMMABLE GAS USAGE	\$ 50
5412B24	PRIVATE PLANT	\$ 145
<b>TOTAL \$</b>		<b>375</b>

This PERMIT is issued and accepted on condition that all Fire Prevention Code provisions now adopted, or that may hereafter be adopted, shall be complied with, and said PERMIT will become valid only after receipt of total fee payment.

THIS PERMIT EXPIRES

08/31/96

This permit does not take the place of any License required by law and is not transferable. Any change in the use or occupancy of premises shall require a new permit.

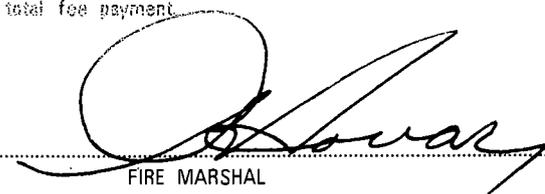  
FIRE MARSHAL

THIS PERMIT MUST AT ALL TIMES BE KEPT ON FILE AT THE PREMISES MENTIONED ABOVE

RECEIVED CLERK  
08/02/95 11:46AM

C CLERK 02

I FIRE FVN 3/5.00  
SUBTOTAL 3/5.00  
TOTAL 3/5.00  
CHECK 3/5.00  
# 11EM I

21 4-3 02 0101 08/02/95 11:46A

Permit fee payments not received by the due date will be considered delinquent.

These delinquent properties operating with invalid permits will be subject to the issuance of a Municipal Code Violations Summons pursuant to Chapter 54-10 of the Municipal Code.

Municipal Code Summons Schedule

	Initial	Default
1st Offense, or after 30 days	\$ 75.00	\$150.00
2nd Offense, or after 60 days	\$150.00	\$300.00
3rd Offense, or after 90 days	\$375.00	\$750.00

# FIRE SAFETY INSPECTION RECORD

LICENSE

2-186  
 GENERAL  
 PUBLIC ED  
 PERMIT  
 HIGH-RISE



LOCATION: 788 RIDGE RD W WARD, C P INC

DATE RECEIVED IN FIRE SAFETY:

APPOINTMENT

PERSON CONTACTED

NO ENTRY

ORDERS ISSUED

REFERRALS ISSUED

NO WORK DONE

SOME WORK DONE

OTHER

OK TO FILE

INSPECTOR

DATE

6/27/95

7/14/95

7/31/95

10 AM

X

X 6 CORR

X 4 CORR

6610

EF.

X EF.



City of Rochester  
 FIRE DEPARTMENT  
 OFFICE OF THE FIRE MARSHAL

Room 300  
 Public Safety  
 Civic Center  
 Rochester, N.Y.  
 (716) 428-7000

**NOTICE OF VIOLATIONS**

C.P. Ward  
 800 W. Ridge Road  
 Rochester, New York 14615

June 28, 1995

PLEASE TAKE NOTICE that an inspection on June 27, 1995, at 800 W. Ridge Road, Rochester, New York, reveal violation(s) of the Fire Prevention Code of the City of Rochester and/or the Codes, Rules and Regulations of the State of New York.

Orders are hereby issued for the violation(s) to be corrected on or before the reinspection schedule for July 14, 1995. failure to comply with these orders will result in the issuance of a municipal code violation summons for each uncorrected violation with the following penalties:

	INITIAL	FAILURE TO RESPOND
1ST OFFENSE	\$ 75.00	\$150.00
2ND OFFENSE	150.00	300.00
3RD OFFENSE	375.00	750.00

During this period, the property owner continues to be responsible and liable for any damages arising from the violation(s).

Relevant section(s) of the New York State Uniform Fire Prevention and Building Code (Title 9NYCRR) to wit:

1171.3(b)(3)(iii) C1 OCCUPANCIES. Storage shall be prohibited except that which is required for maintenance and operation of building and operation of equipment. Such storage shall be kept in closed metal containers stored in a storage cabinet or in safety cans or in an inside storage room not having a door that opens into that portion of the building used by the public.

1194.1(a) Fire safety signs include, among others: occupancy signs, limiting the maximum number of occupants permitted in public areas; no smoking signs, prohibiting smoking in areas where conditions exist which make smoking a fire hazard; danger signs, alerting persons to areas where special danger of fire or explosion exists; elevator warning signs, instructing occupants to use exit stairs in case of fire; and incinerator warning signs, prohibiting the disposal of lighted, flammable, combustible or explosive materials in the incinerator.

1194.1(b) Fire safety signs shall be posted on premises as specified in subdivision 1194.1(a) of this section.

THE METAL CABINET IN THE REPAIR SHOP SHALL HAVE THE EXTRA FLAMMABLE LIQUIDS STORED IN IT AND A FLAMMABLE ON ITS DOOR. ✓✓



City of Rochester  
FIRE DEPARTMENT  
OFFICE OF THE FIRE MARSHAL

Room 300  
Public Safety Bldg  
Civic Center Plaza  
Rochester, New York  
(716) 428-7037

# NOTICE OF VIOLATIONS

PAGE 2

1194.1(a) Fire safety signs include, among others: occupancy signs, limiting the maximum number of occupants permitted in public areas; no smoking signs, prohibiting smoking in areas where conditions exist which make smoking a fire hazard; danger signs, alerting persons to areas where special danger of fire or explosion exists; elevator warning signs, instructing occupants to use exit stairs in case of fire; and incinerator warning signs, prohibiting the disposal of lighted, flammable, combustible or explosive materials in the incinerator.

1194.1(b) Fire safety signs shall be posted on premises as specified in subdivision 1194.1(a) of this section.

A NO SMOKING AND FLAMMABLE GAS SIGN SHALL BE POSTED AT THE STORAGE RACK FOR THE ACETYLENE AND NO SMOKING AT ALL FUEL DISPENSERS. ✓✓

1162.2(d) No aisle or passageway shall be obstructed so as to reduce its required width as an exit.

THE RECORD AND TIRE STORAGE AREA SHALL HAVE A GENERAL CLEAN UP PROVIDING BETTER AISLE SPACE. ✓

1163.11(g) All exposed wiring shall be enclosed or protected according to applicable generally accepted standards.

THE MISSING KNOCK-OUTS IN THE ELECTRICAL PANEL BOX IN THE FILTER ROOM SHALL BE REPLACED. ✓✓

1171.1(d) Containers having a capacity of 10 gallons or more, and equipment used for flammable liquids, shall be electrically bonded or grounded during transfer of liquids.

THE 55 GALLON FLAMMABLE LIQUID DRUM USED FOR DISPENSING SHALL BE GROUNDED AND HAVE A BONDING WIRE FOR DISPENSING (METHANOL) INTO SMALLER CONTAINERS. ✓✓

BY ORDER OF THE FIRE MARSHAL INSPECTOR

  
EDWARD FERRANTE 6610

DATE OF COMPLIANCE 7/31/85 INSPECTOR





City of Rochester  
FIRE SAFETY DIVISION  
FOR INTERNAL USE ONLY

DATE: 6-27-95 Page \_\_\_\_\_ of \_\_\_\_\_

BUSINESS NAME: CP. WARD INC OWNER: \_\_\_\_\_

MAILING ADDRESS: 800 W RIDGE RD Zip \_\_\_\_\_ ADDRESS: \_\_\_\_\_ Zip \_\_\_\_\_

ADDRESS OF VIOLATIONS: - SAME - CITY: \_\_\_\_\_

ATTENTION: - BILL - REINSPECTION DATE: 7-14-95

621-5450 on 721-9879

CODE VIOLATION #	DESCRIPTION AND/OR LOCATION OF VIOLATION
116.2D	- THE RECORD & TOOL STORAGE AREA'S SHALL HAVE A GENERAL CLEAN UP PROVIDING BETTER TABLE SPACE
1194.1A&B	- A NO SMOKING & FLAMM GAS SIGN SHALL BE POSTED AT THE STORAGE PACT FOR THE APPROXIMATE NO SMOKING AT ALL Fuel Dispensers
116.11G	- THE MISSING <sup>Electrical</sup> FUSIBLE LINKS IN THE PANEL BE IN THE FILTER RM SHALL BE REPLACED
1171.3B3(C)(ii) 1194.1A&B	- THE METAL CABINET IN THE REPAIR SHOP SHALL HAVE THE EXTRA FLAMM LIQ'S STORED IN IT AND A <sup>FLAMM</sup> SIGN ON ITS DOOR
1171.1D	- THE 55 GAL FLAMM LIQ DRUM USED FOR DISPENSING SHALL BE GROUNDED & HAVE A BONDING WIRE FOR DISPENSING (METHANOL) INTO SMALLER CONTAINERS

INSPECTOR: ED FERRANTE

IBM# 6610



BUILDING INSPECTION / COMPLAINT FORM



02359

COMPANY E10	INSPECTION #	
ADDRESS RIDGE RD W 788	TAX ACCT #	018888-00.0
PROPERTY OWNER C P WARD INC	ADDRESS 800 W RIDGE RD	PHONE 621-5450
	CITY ROCHESTER	STATE NY
	ADDRESS 800 W RIDGE RD	PHONE 14615
MAILING NAME C P WARD INC	CITY ROCHESTER	STATE NY
	ADDRESS 563 NORTH RD	PHONE 889-9362
EMERGENCY CONTACT BILL KEIHL	CITY SCOTTSVILLE	STATE NY
		ZIP 14546

NFPA 901 CODES	GENERAL PROPERTY USE <b>80</b>	SPECIFIC PROPERTY USE <b>891</b>	STRUCTURE TYPE <b>2</b>	STRUCTURE STATUS <b>2</b>
----------------	--------------------------------	----------------------------------	-------------------------	---------------------------

NO ENTRY DATES:	BUSINESS NAME VALLEY SAND & GRAVEL	PHONE	DISPOSITION by FIRE SAFETY:			
	BUSINESS OWNER		REFERRED	ORDERS ISSUED	CORRECTED	NOT REQUIRED
A = ATTIC C = CELLAR G = GARAGE O = OUTSIDE # = FLOOR #	ADDRESS 788 W. RIDGE RD	ROCHESTER NY14615				
	BUSINESS EMERGENCY RICHARD ASH	721 3102				
	ADDRESS 2626 RIVER RD	PITTSFORD NY14533				
	PHONE 226 3190					
	SPECIAL INSTRUCTIONS:					
	SPECIAL HAZARDS OR CONSTRUCTION					
DIRECTION ROOM #, ETC.	COMPLAINT					
	<i>Office area OK at this time</i>					

OFFICER PREPARING REPORT: <i>Lt. D. Adams</i>	COMPANY E-10	DISTRICT 1	GROUP 1	DATE 6-3-94
BUS/PROP REPRESENTATIVE: <i>Gwen Donato</i>	POSITION / TITLE <i>Office Manager</i>			DATE 6-3-94
FIRE SAFETY INSPECTOR:	<b>G.D. EISENHART LIEUTENANT</b>			

RFD 501 REV. 12/90



City of Rochester  
FIRE DEPARTMENT  
OFFICE OF THE FIRE MARSHAL

Room 300  
Public Safety Building  
Civic Center Plaza  
Rochester, New York 14614  
(716) 428-7037

## NOTICE OF VIOLATIONS

Bill Keogh  
C.P. Ward Inc.  
800 W. Ridge Road  
Rochester, New York 14615

June 21, 1994

PLEASE TAKE NOTICE that an inspection on June 15, 1994, at 788 W. Ridge Road, Rochester, New York, reveal violation(s) of the Fire Prevention Code of the City of Rochester and/or the Codes, Rules and Regulations of the State of New York.

Orders are hereby issued for the violation(s) to be corrected on or before the reinspection schedule for June 29, 1994. Failure to comply with these orders will result in the issuance of a Municipal Code Violation Summons for each uncorrected violation with the following penalties:

	INITIAL	FAILURE TO RESPOND
1ST OFFENSE	\$ 75.00	\$150.00
2ND OFFENSE	150.00	300.00
3RD OFFENSE	375.00	750.00

During this period, the property owner continues to be responsible and liable for any damages arising from the violation(s).

Relevant section(s) of the New York State Uniform Fire Prevention and Building Code (Title 9NYCRR) to wit:

1162.2(f) Exit access and exit discharge areas shall be so maintained as to provide a permanent, reasonable straight path of travel unimpeded by railings, barriers or gates dividing such areas into sections ancillary to adjoining individual rooms or spaces.

SCREEN DOORS SHALL SWING OUT (MOBIL OFFICE AREA).

1163.3(d) Containers shall be protected against physical damage, and located so as not to be a hazard to the premises served.

Containers shall rest on noncombustible supports.

PROPANE TANKS SHALL BE SECURE PROPERLY.



City of Rochester  
FIRE DEPARTMENT  
OFFICE OF THE FIRE MARSHAL

Room 300  
Public Safety Building  
Civic Center Plaza  
Rochester, New York 14614  
(716) 428-7037

# NOTICE OF VIOLATIONS

PAGE 2

1164.3(a)(2) All existing equipment, piping, tanks, electrical systems, and dispensers shall be in compliance with the requirements specified in paragraph 1164.3(a)(1) of this subdivision except they may be permitted to continue in use if they do not constitute a distinct hazard to life or property.

1. LEAK ON GASOLINE PUMP SHALL BE REPAIR.
2. ~~ELECTRICAL WIRES SHALL BE REMOVED.~~ (DEISEL PUMP NO LONGER USING.)

BY ORDER OF THE FIRE MARSHAL

INSPECTOR

DATE OF COMPLIANCE 6/29/94

INSPECTOR

ANTHONY GALLIS 6519  
*AG*



**City of Rochester**  
FIRE SAFETY DIVISION  
FOR INTERNAL USE ONLY

2.25

DATE: 6-15-94 Page \_\_\_\_\_ of \_\_\_\_\_

BUSINESS NAME: C. P. Ward Inc OWNER: \_\_\_\_\_

MAILING ADDRESS: 800 W. Ridge Rd Zip 14615 ADDRESS: \_\_\_\_\_ Zip \_\_\_\_\_

ADDRESS OF VIOLATIONS: 788 W. Ridge Rd CITY: \_\_\_\_\_

ATTENTION: Bell Keogh REINSPECTION DATE: 6-29-94

CODE VIOLATION #	DESCRIPTION AND/OR LOCATION OF VIOLATION
<del>1163.3(d)</del>	Propane tanks shall be secured properly.
<del>1164.3a(2)</del>	Leak on gasoline pump shall be repaired
<del>1164.3a(2)</del>	Electrical wires shall be removed. (Diesel pump no longer using.)
1162.2(F)	Screen doors shall <del>be</del> swing out <del>at</del> . (mobil office area)
	621-5450

INSPECTOR: DeWitt IBM# 6519

(call)

# FIRE SAFETY INSPECTION RECORD

LICENSE

2-25  
 GENERAL  
 PUBLIC ED  
 PERMIT  
 HIGH-RISE

LOCATION: 788 RIDGE RD W

WARD, C P INC

DATE RECEIVED IN FIRE SAFETY:

APPOINTMENT

PERSON CONTACTED

NO ENTRY

ORDERS ISSUED

REFERRALS ISSUED

NO WORK DONE

SOME WORK DONE

4 Com

OTHER

OK TO FILE

INSPECTOR

DATE

6/15/94

6/29/94

1 Pm

X

6519

X 6519



City of Rochester  
FIRE DEPARTMENT  
OFFICE OF THE FIRE MARSHAL

Room 300  
Public Safety Building  
Civic Center Plaza  
Rochester, New York 14614  
(716) 428-7037

# NOTICE OF VIOLATIONS

Bill Keihl  
Ward, C. P. Inc.  
800 W. Ridge Road  
Rochester, New York 14615

June 24, 1993

PLEASE TAKE NOTICE that an inspection on June 23, 1993, at 788 W. Ridge Road, Rochester New York, reveal violation(s) of the Fire Prevention Code of the City of Rochester and/or the Codes, Rules and Regulations of the State of New York.

Orders are hereby issued for the violation(s) to be corrected on or before the reinspection schedule for July 7, 1993. Failure to comply with these orders will result in the issuance of a Municipal Code Violation Summons for each uncorrected violation with the following penalties:

	INITIAL	FAILURE TO RESPOND
1ST OFFENSE	\$ 75.00	\$150.00
2ND OFFENSE	150.00	300.00
3RD OFFENSE	375.00	750.00

During this period, the property owner continues to be responsible and liable for any damages arising from the violation(s).

Relevant section(s) of the New York State Uniform Fire Prevention and Building Code (Title 9NYCRR) to wit:

1162.2(a) Exits shall be maintained to provide free and unobstructed egress from all parts of the building or structure. OBSTRUCTION SHALL BE REMOVE FROM EXIT DOOR (WEST DOOR OFFICE AREA).

1163.3(d) Containers shall be protected against physical damage, and located so as not to be a hazard to the premises served. Containers shall rest on noncombustible supports. PROPANE TANKS SHALL BE STORED PROPERLY (SHED).

1163.6(b)(1) Storage tanks above ground shall rest on noncombustible supports that are maintained in a structurally sound condition. 275 GALLON KEROSENE TANK SHALL BE REPAIR. GRASS AROUND TANK SHALL BE REMOVE.

1163.13(f)(4) Portable fire extinguishers shall be maintained in a proper operating condition at all times. MISSING TAG ON FIRE EXTINGUISHER SHALLBE REPLACE (REAR EXIT DOOR OF SHOP).



City of Rochester  
FIRE DEPARTMENT  
OFFICE OF THE FIRE MARSHAL

Room 300  
Public Safety Building  
Civic Center Plaza  
Rochester, New York 14614  
(716) 428-7037

## NOTICE OF VIOLATIONS

PAGE 2

1171.3(b)(3)(v)(f)(4) Flammable or combustible liquids shall not be dumped on the ground, into sewers, drainage ditches or storm drains, but shall be stored in tanks or tight drums outside of any building until removed from the premises. Leaking containers shall be removed or repaired.

OIL TOP OF CLAY TANK SHALL BE CLEAN UP.

1191.1(a) Precautions shall be taken to protect property and premises against the starting and spreading of fires. <CI-244> GENERAL CLEAN UP SHALL BE MADE, REMOVE SOME STORAGE TO REDUCE WEIGHT LOAD (LOFT AREA).

1194.1(a) Fire safety signs include, among others: occupancy signs limiting the maximum number of occupants permitted in public areas; no smoking signs prohibiting smoking in areas where conditions exist which make smoking a fire hazard; danger signs alerting persons to areas where special danger of fire or explosion exists; elevator warning signs instructing occupants to use exit stairs in case of fire; and incinerator warning signs prohibiting the disposal of lighted, flammable, combustible or explosive materials in the incinerator.

WASTE PRODUCT DRUMS SHALL BE LABEL. (WEST SIDE OF BUILDING)

BY ORDER OF THE FIRE MARSHAL

INSPECTOR

ANTHONY GALLIS 6519

DATE OF COMPLIANCE 7/29/93

INSPECTOR

*Anthony Gallis*





BUILDING INSPECTION / COMPLAINT FORM



COMPANY E10  
ADDRESS  
RIDGE  
PROPERTY OWNER

FROM / TO  
788

INSPECTION #  
TAX ACCT #  
018888-00.0  
PHONE

05770

RD W  
C P WARD INC

ADDRESS  
800 W RIDGE RD  
CITY ROCHESTER STATE NY ZIP 621-5450  
14615

MAILING NAME  
WARD/VALLEY SUBSIDIARY INC

ADDRESS  
800 W RIDGE RD  
CITY ROCHESTER STATE NY ZIP 14615  
PHONE 889 9362

EMERGENCY CONTACT  
-RICHARD C MACK ~~Bill Keihl~~ BILL KEIHL

ADDRESS  
385 PHELPS RD 563 NORTH RD  
CITY HONEOYE FALLS STATE NY ZIP 533-1392  
SCOTTSVILLE NY 14472  
14546

NFPA 901 CODES	GENERAL PROPERTY USE <u>80</u>	SPECIFIC PROPERTY USE <u>891</u>	STRUCTURE TYPE <u>2</u>	STRUCTURE STATUS <u>2</u>
----------------	--------------------------------	----------------------------------	-------------------------	---------------------------

NO ENTRY DATES:	BUSINESS NAME VALLEY SAND & GRAVEL INC PHONE	DISPOSITION by FIRE SAFETY:
	BUSINESS OWNER	
A = ATTIC C = CELLAR G = GARAGE O = OUTSIDE # = FLOOR #	ADDRESS 788 W RIDGE RD ROCHESTER NY14615 PHONE 865 5910	REFERRED ORDERS ISSUED CORRECTED NOT REQUIRED
	BUSINESS EMERGENCY <del>ROBERT YOUNG</del> RICHARD ASH ADDRESS <del>20 WATERWORKS LN</del> FAIRPORT NY14450 <u>2626 RIVER RD</u> <u>PIFFARD NY</u> PHONE <u>223 5736</u> <u>226-3190</u>	
	SPECIAL INSTRUCTIONS: <u>14533</u> <u>OR 721-3102</u>	
	SPECIAL HAZARDS OR CONSTRUCTION	
DIRECTION ROOM #, ETC.	COMPLAINT	
	<u>NO VIOLATIONS AT THIS TIME</u>	

OFFICER PREPARING REPORT: <i>VA [Signature]</i>	COMPANY E-10	DISTRICT 1	GROUP 7	DATE 6-28-93
BUS/PROP REPRESENTATIVE: BOB GANIEWSKI	POSITION / TITLE SERVICE MGR			DATE 6-28-93
FIRE SAFETY INSPECTOR:				DATE





City of Rochester  
FIRE DEPARTMENT  
OFFICE OF THE FIRE MARSHAL

Room 300  
Public Safety Building  
Civic Center Plaza  
Rochester, New York 14614  
(716) 428-7037

## NOTICE OF VIOLATIONS

Mary Ellen Joy  
C. P. Ward Inc.  
880 W. Ridge Road  
Rochester, New York 14615

June 8, 1992

PLEASE TAKE NOTICE THAT an inspection at 788 W. Ridge Road, Rochester, New York, reveals Violation(s) of the Fire Prevention Code of the City of Rochester and/or the Codes, Rules and Regulations of the State of New York.

Orders are hereby issued for the violation(s) to be corrected on or before the reinspection scheduled for June 19, 1992. Failure to comply with these orders will result in the issuance of a Municipal Code Violation Summons for each uncorrected violation with the following penalties:

	INITIAL	FAILURE TO RESPOND
1ST OFFENSE	\$ 50.00	\$100.00
2ND OFFENSE	100.00	200.00
3RD OFFENSE	250.00	500.00

During this period, the property owner continues to be responsible and liable for any damages arising from the violation(s).

Relevant section(s) of the New York State Uniform Fire Prevention and Building Code (Title 9NYCRR) to wit:

1191.1a Precautions shall be taken to protect property and premises against the starting and spreading of fires. <CI-244>  
GENERAL CLEAN UP SHALL BE MADE IN PARTS STORAGE AREA.

BY ORDER OF THE FIRE MARSHAL

INSPECTOR

COMPLIANCE

6/30/92

Anthony Gallis, 6519

INSPECTOR

[Signature]



# FIRE SAFETY INSPECTION RECORD

LICENSE

0-2-429

GENERAL  
 PUBLIC ED  
 PERMIT  
 HIGH-RISE

LOCATION: 788 RIDGE RD W

WARD, C P INC

DATE RECEIVED IN FIRE SAFETY:

3 cars

OTHER

APPOINTMENT

PERSON CONTACTED

NO ENTRY

ORDERS ISSUED

REFERRALS ISSUED

NO WORK DONE

SOME WORK DONE

OK TO FILE

INSPECTOR

DATE

6/14/91

7/12/91

7-23-91

X

x

6519

6519

X 6519





City of Rochester  
FIRE DEPARTMENT  
OFFICE OF THE FIRE MARSHAL

Room 300  
Public Safety Building  
Civic Center Plaza  
Rochester, New York 14614  
(716) 428-7037

NOTICE OF VIOLATIONS

Mary Ellen Jay  
C.P. Ward Inc.  
800 W. Ridge Road  
Rochester, New York 14615

June 25, 1991

PLEASE TAKE NOTICE THAT an inspection at 800 W. Ridge Road, Rochester, New York reveals violation(s) of the Fire Prevention Code of the City of Rochester and/or the Codes, Rules and Regulations of the State of New York.

Orders are hereby issued for the violation(s) to be corrected on or before the reinspection scheduled for July 12, 1991. Failure to comply with these orders will result in the issuance of a Municipal Code Violation Summons for each uncorrected violation with the following penalties:

	INITIAL	FAILURE TO RESPOND
1st OFFENSE	\$ 50.00	\$100.00
2nd OFFENSE	100.00	200.00
3rd OFFENSE	250.00	500.00

During this period, the property owner continues to be responsible and liable for any damages arising from the violation(s).

Relevant section(s) of the New York State Uniform Fire Prevention and Building Code (Title 9 NYCRR) to wit:

(OIL STORAGE AREA)

1163.3d Containers shall be protected against physical damage, and located so as not to be a hazard to the premises served. Containers shall rest on noncombustible supports.  
PROPANE TANKS SHALL BE STORED PROPERLY.

1191.1a Precautions shall be taken to protect property and premises against the starting and spreading of fires. <CI-244>  
DIKE SHALL BE CLEANED.

1164.3a-2 All existing equipment, piping, tanks electrical systems, and dispensers shall be in compliance with the requirements specified in section 1164.3a-1 except they may be permitted to continue in use if they do not constitute a distinct hazard to life or property.  
HOSE SHALL BE KEPT OFF GROUND - UNLEADED PUMP.

BY ORDER OF THE FIRE MARSHAL    INSPECTOR Anthony Gallis 6519  
DATE OF COMPLAINT    7/25/91    INSPECTOR Atall



# FIRE SAFETY INSPECTION RECORD

LICENSE

V 2-254

GENERAL  
PUBLIC ED  
PERMIT  
HIGH-RISE

LOCATION: 788 RIDGE ROAD W. C P WARD INC

DATE RECEIVED  
IN FIRE  
SAFETY:

APPOINTMENT

PERSON  
CONTACTED

NO ENTRY

ORDERS ISSUED

REFERRALS ISSUED

NO WORK DONE

SOME WORK DONE

*6 car*

OTHER

OK TO FILE

INSPECTOR

DATE

06-20-90

GALLIS

06-29-90

X *Gallis*



City of Rochester  
 FIRE SAFETY DIVISION  
 FOR INTERNAL USE ONLY

V-2-254

PAGE \_\_\_\_ OF \_\_\_\_

DATE 6-20-90

BUSINESS NAME Ward, C.P. Inc

OWNER: \_\_\_\_\_

MAILING ADDRESS 788 Ridge Rd W ZIP 14615

ADDRESS: \_\_\_\_\_

ADDRESS OF VIOLATIONS: \_\_\_\_\_

CITY: \_\_\_\_\_ ZIP \_\_\_\_\_

ATTENTION: Linus Lawler

621-5450

REINSPECTION DATE: ~~6-29-90~~ 6-29-90 (Call day before)

CODE VIOLATION #	DESCRIPTION and/or LOCATION OF VIOLATION
1163.8e-2	① Wooden steps to waste oil heater shall be replaced with non <del>combustible</del> <sup>combustible</sup> one
1191.1(a)	② Excess oil under steps shall be cleaned up.
1191.1(a)	③ A general clean up of parts room shall be made.
1163.3(e)	④ L.P.G tanks shall be stored and chained properly. (Empty or Full)
1175.1(d)	⑤ All compress air bottles shall be chained. (Empty or <del>Full</del> Full)
1175.1(b)	⑥ Compress air bottles shall be stored properly (acetylene away from other bottles.)



City of Rochester  
 FIRE DEPARTMENT  
 OFFICE OF THE FIRE MARSHAL

Room 300  
 Public Safety Building  
 Civic Center Plaza  
 Rochester, New York 14614  
 (716) 428-7037

**NOTICE OF VIOLATIONS**

C. P. Ward, Inc.  
 Attention: Linus D. Lawler  
 800 West Ridge Road  
 Rochester, New York 14615

June 21, 1990

PLEASE TAKE NOTICE THAT  
 an inspection at 800 W. Ridge Road Rochester, New York  
 reveals violation(s) of the Fire Prevention Code of the City of  
 Rochester and/or the Codes, Rules and Regulations of the State of New  
 York.

Orders are hereby issued for the violation(s) to be corrected on or  
 before the reinspection scheduled for June 29, 1990.

Failure to comply with these orders will result in the issuance of a  
 Municipal Code Violation Summons for each uncorrected violation with  
 the following penalties:

	INITIAL	FAILURE TO RESPOND
1st OFFENSE	\$ 50.00	\$100.00
2nd OFFENSE	100.00	200.00
3rd OFFENSE	250.00	500.00

During this period, the property owner continues to be responsible and  
 liable for any damages arising from the violation(s).

Relevant section(s) of the New York State Uniform Fire Prevention and  
 Building Code (Title 9 NYCRR) to wit:

1163.3e Liquefied petroleum gases shall be odorized, so that the  
 presence of gas will be recognizable by a distinct odor.  
 (LPG TANKS SHALL BE STORED AND CHAINED PROPERLY EMPTY OR FULL).

1163.8e-2 If the heat source is not within an enclosure, then  
 combustible materials shall not be stored within 36 inches of such  
 device.

(WOODEN STEPS TO WASTE OIL HEATER SHALL BE REPLACED WITH  
 NONCOMBUSTIBLE STEPS).



City of Rochester  
FIRE DEPARTMENT  
OFFICE OF THE FIRE MARSHAL

Room 300  
Public Safety Building  
Civic Center Plaza  
Rochester, New York 14614  
(716) 428-7037

## NOTICE OF VIOLATIONS

PAGE 2 OF 2

1191.1a Precautions shall be taken to protect property and premises against the starting and spreading of fires. (1-EXCESS OIL UNDER STEPS SHALL BE CLEANED UP. 2-A GENERAL CLEAN UP OF THE PARTS ROOM SHALL BE MADE).

1175.1b Compressed gases shall be stored, handled, and used in accordance with generally accepted standards. (COMPRESSED AIR BOTTLES SHALL BE STORED PROPERLY [ACETYLENE AWAY FROM OTHER BOTTLES]).

1175.1d Compressed gas cylinders in storage or in service shall be secured to prevent falling or being upset and shall be protected against tampering by unauthorized persons. (ALL COMPRESSED AIR BOTTLES SHALL BE CHAINED - EMPTY OR FULL.

BY ORDER OF THE FIRE MARSHAL

INSPECTOR:

ANTHONY GALLIS 6519

DATE OF COMPLIANCE

6/29/98

INSPECTOR:

*A Gallis*







**CITY OF ROCHESTER, NEW YORK  
APPLICATION FOR BUILDING PERMIT**

Permit Number 890584 -

I. IDENTIFICATIONS (Please Print) 10926

Location of Work (street address) 798 800 RIDGET ROAD WEST Rochester, New York 14615

Owner's Name G. P. WARD Phone 716 621-5450

Contractor's Name CITY PUMP & TANK SER Phone 716 288-0001

Arch./Eng. Name \_\_\_\_\_ Phone \_\_\_\_\_

Applicant's Name CHARLES BAUERSCHMIDT Phone 716 288-0001

Applicant's Address 1723 CLIFFORD City ROCHESTER State & Zip NY 14609

II. PROPOSED WORK (check One or More)

<input type="checkbox"/> New Const.	<input type="checkbox"/> Amusement, Tent	<input type="checkbox"/> Metal Sidings
<input checked="" type="checkbox"/> Addition	<input type="checkbox"/> Antenna	<input type="checkbox"/> Paving
<input type="checkbox"/> Alteration	<input type="checkbox"/> Awning	<input type="checkbox"/> Sign
<input type="checkbox"/> Change Use	<input type="checkbox"/> Elevator	<input type="checkbox"/> Sprinkler System
<input type="checkbox"/> Relocate	<input type="checkbox"/> Fence, Walls	<input type="checkbox"/> Stair Enclosure
<input type="checkbox"/> Demolish	<input type="checkbox"/> Fire Escape	<input type="checkbox"/> Standpipe System
<input type="checkbox"/> Other	<input type="checkbox"/> Fire-Smoke Detec.	<input type="checkbox"/> Swimming Pool
	<input type="checkbox"/> Heating, Air Cond.	<input checked="" type="checkbox"/> Tanks, Pipes & Pumps

III. COST ESTIMATE

- excluding electrical and plumbing work

- including heating, air-conditioning and elevator etc.

\$ 750.00

IV. CERTIFICATION (Sign in Presence of Plan Reviewer)

I am the owner / contractor / engineer / or owner's agent authorized by the owner to make this application.

Applicant's Signature George V. Marek Date 3-16-89

V. OCCUPANCY OR USE

Residential		Non-Residential	
Present	Proposed	Present	Proposed
<input type="checkbox"/> A1 One-Family Dwelling	<input type="checkbox"/>	<input type="checkbox"/> C1 Business	<input type="checkbox"/>
<input type="checkbox"/> A2 Two-Family Dwelling	<input type="checkbox"/>	<input type="checkbox"/> C2 Mercantile	<input type="checkbox"/>
<input type="checkbox"/> Multiple Dwelling (indicate number of units)	<input type="checkbox"/>	<input type="checkbox"/> C3 Industrial	<input type="checkbox"/>
<input type="checkbox"/> B1 Permanent Occupancy	<input type="checkbox"/>	<input type="checkbox"/> C4 Storage	<input type="checkbox"/>
<input type="checkbox"/> B2 Transient Occupancy	<input type="checkbox"/>	<input type="checkbox"/> C5 Assembly	<input type="checkbox"/>
<input type="checkbox"/> B3 Senior Citizens House	<input type="checkbox"/>	<input type="checkbox"/> C6 Institutional	<input type="checkbox"/>
<input type="checkbox"/> B4 Adult Res. Care Facil.	<input type="checkbox"/>	<input type="checkbox"/> C7 Miscellaneous	<input type="checkbox"/>

710

VI. CERTIFICATE OF OCCUPANCY YES/NO NO

VII. PERMIT FEE

Bureau Est. \$ \_\_\_\_\_

Permit Fee \$ 30 x 3 = 90

VIII. PERMIT DESCRIPTION Install (3) <sup>500 gal</sup> above ground sugar air pumps tanks

X. FEE PAID BUILDING BUREAU

MAR 16 '89 03:24PM

KIM 02

3117	
1 BLDGPERM	90.00
SUBTOTAL	90.00
TOTAL	90.00
BP788RIDGERDW	
CHECK	90.00
# ITEMS	1

0910 02 0101

IX. APPROVALS

Zon. Dist. NI CZC # 24056

Zoning BARRY WOLFE Date 7/14/89

Fire Safety St. David Penny Date 3-17-89

Plumbing \_\_\_\_\_ Date \_\_\_\_\_

D.E.S. \_\_\_\_\_ Date \_\_\_\_\_

Demolition \_\_\_\_\_ Date \_\_\_\_\_

Buildings Jack Leonard Date 3/17/89

for Commissioner of Community Development

XI. INSURANCE YES/NO 7/16/89

XII. BB / IS / FS / DE

XIII. PLANS YES/NO NO



# NOTICE OF VIOLATIONS

DATE 8-11-87

C.P. Ward Inc  
 Name

800 W Redox Rd  
 Address

Inspection of premises located at 788 Redox Rd W. reveals violations of the Fire Prevention Code. Orders are hereby issued for correction of hazards listed herewith on or before: 8-21-87

Failure to comply with these orders may result in issuance of Municipal Code Violation Ticket with following penalties:

	INITIAL	FAILURE TO RESPOND
1st OFFENSE	\$ 50	\$100
2nd OFFENSE	\$100	\$200
3rd & SUBSEQUENT	\$250	\$500

9211C RR

Bob Young - 621-5450

116.3b (1) Ground area around steel drums shall be cleaned up.

Main Shop Sub Area

1171. (2) missing covers on drums shall be replaced.

(3) Grass on top of drums shall be removed.

(4) General clean up of the area shall be made.

Rear Shop Area

(5) Shall have a general clean up outside of Bldg

1171.6 (6) All drums + above ground (1) tank shall be labeled.

By Order of  
 FIRE MARSHAL

INSPECTOR William Hallis 6519

DATE of COMPLIANCE 9-2-87

Inspector A Hallis



BUILDING INSPECTION / COMPLAINT FORM

COMPANY <b>E10</b>	INSPECTION # <b>007142</b>
ADDRESS <b>RIDGE RD W</b>	FROM / TO <b>798</b>
PROPERTY OWNER	TAX ACCT. # <b>018888-00.0</b>
Mailing Name <b>C F WARD INC</b>	Address <b>300 W RIDGE RD</b>
City <b>ROCHESTER</b>	State <b>NY</b>
Address <b>300 W RIDGE RD</b>	Phone <b>621-5450</b>
City <b>ROCHESTER</b>	State <b>NY</b>
Address <b>2626 RIVER RD</b>	Phone <b>226-3190</b>
City <b>PIFFARD</b>	State <b>NY</b>
Emergency Contact <b>RICHARD ASH</b>	Phone <b>145-33</b>

NFPA 901 CODES	GENERAL PROPERTY USE <b>52</b>	SPECIFIC PROPERTY USE <b>808</b>	STRUCTURE TYPE <b>1</b>	STRUCTURE STATUS <b>2</b>
----------------	--------------------------------	----------------------------------	-------------------------	---------------------------

A = ATTIC C = CELLAR G = GARAGE O = OUTSIDE # = FLOOR #	BUSINESS NAME <b>WARD C F INC</b>	PHONE	DISPOSITION by FIRE SAFETY:			
	BUSINESS OWNER ADDRESS <b>780 Ridge Rd. West</b>	PHONE	REFERRED	ORDERS ISSUED	CORRECTED	NOT REQUIRED
BUSINESS EMERGENCY ADDRESS	PHONE	COMPLAINT				
DIRECTION, ROOM #, ETC.	<i>None at this time</i>					

OFFICER PREPARING REPORT: <i>H. J. Young</i>	COMPANY <b>E10</b>	GROUP <b>4</b>	DATE <b>6/2/07</b>
BUS/PROP REPRESENTATIVE: <i>Mary Ellen Joy</i>	POSITION / TITLE <b>Administrative Asst</b>		DATE
FIRE SAFETY INSPECTOR:			DATE

RFID 501

V334

701226

# FIRE SAFETY INSPECTION RECORD

- LICENSE
- TANK REMOVAL

GENERAL  
PUBLIC ED.  
PERMIT

LOCATION: 788 W. RIDGE ROAD

C P WARD INC

12 car

DATE RECEIVED  
FIRE SAFETY:

APPOINTMENT

PERSON CONTACTED

NO ENTRY  
ORDERS ISSUED

REFERRALS ISSUED

NO WORK DONE

SOME WORK DONE

OTHER

OK TO FILE  
INSPECTION

DATE

8/11/87

X

Wed - 10 AM

GALLIS

8/21/87

X 6519



BUILDING INSPECTION / COMPLAINT FORM

COMPANY <b>E10</b>	INSPECTION # <b>007143</b>
ADDRESS <b>RIDGE RD W</b>	FROM / TO <b>788</b>
PROPERTY OWNER	TAX ACCT. # <b>018888-00.0</b>
MILING NAME <b>C P WARD INC</b>	ADDRESS <b>800 W RIDGE RD</b>
EMERGENCY CONTACT <b>RICHARD ASH</b>	CITY <b>ROCHESTER</b> STATE <b>NY</b> ZIP <b>14615</b>
	ADDRESS <b>800 W RIDGE RD</b>
	CITY <b>ROCHESTER</b> STATE <b>NY</b> ZIP <b>14615</b>
	ADDRESS <b>2626 RIVER RD</b>
	CITY <b>PIFFARD</b> STATE <b>NY</b> ZIP <b>14533</b>

NFPA 901 CODES	GENERAL PROPERTY USE <b>52</b>	SPECIFIC PROPERTY USE <b>591</b>	STRUCTURE TYPE <b>1</b>	STRUCTURE STATUS <b>2</b>
----------------	--------------------------------	----------------------------------	-------------------------	---------------------------

- A = ATTIC
- C = CELLAR
- G = GARAGE
- O = OUTSIDE
- # = FLOOR #

BUSINESS NAME <b>WARD C P INC</b>	PHONE
BUSINESS OWNER	
ADDRESS <b>800 Ridge Rd - West</b>	PHONE
BUSINESS EMERGENCY	
ADDRESS	PHONE

DISPOSITION by FIRE SAFETY:

REFERRED	ORDERS ISSUED	CORRECTED	NOT REQUIRED
----------	---------------	-----------	--------------

DIRECTION, ROOM #, ETC.

COMPLAINT

*700 gal combustible liquid stored in back*

OFFICER PREPARING REPORT: <i>A. V. Young</i>	COMPANY <b>E-10</b>	GROUP <b>4</b>	DATE <b>6/8/87</b>
BUS/PROP REPRESENTATIVE: <i>Mary Ellen Jay</i>	POSITION / TITLE <i>Administrative Asst.</i>		DATE <b>6/8/87</b>
FIRE SAFETY INSPECTOR:			DATE

RFD 501

Fire Dept.  
Fire Safety Division  
Public Safety Bldg.  
Rochester, N.Y. 14614



OFFICE OF THE  
FIRE MARSHAL  
TELEPHONE: 428-7037

# NOTICE OF VIOLATIONS

DATE Sept 5, 1984

C.P. Ward Inc  
Name

800 W. Ridge Rd  
Address

Inspection of premises located at same reveals violations of the Fire Prevention Code. Orders are hereby issued for correction of hazards listed herewith on or before: Immediately

Failure to comply with these orders may result in issuance of Municipal Code Violation Ticket with following penalties:

	INITIAL	FAILURE TO RESPOND
1st OFFENSE	\$ 50	\$100
2nd OFFENSE	\$100	\$200
3rd & SUBSEQUENT	\$250	\$500

974 ER

TANK VEHICLE - # 194

1965 Neil # 914432

616 54-12B-109

1. Damaged dome covered gaskets shall be replaced on dome covers.

616 2. Emergency cable for internal valves shall be repaired and made to operate properly.

616 3. Leaks in shut-off valves shall be repaired

OK to file

By Order of  
FIRE MARSHAL

INSPECTOR Joseph Spicenza  
6590

DATE of COMPLIANCE 9/13/84

Inspector Spicenza



3nd

# NOTICE OF VIOLATIONS

DATE Sept 5, 1984

C. P. Ward Inc 800 Ridge Rd W.  
Name Address

Inspection of premises located at same reveals violations of the Fire Prevention Code. Orders are hereby issued for correction of hazards listed herewith on or before: Immediately

Failure to comply with these orders may result in issuance of Municipal Code Violation Ticket with following penalties:

	INITIAL	FAILURE TO RESPOND
1st OFFENSE	\$ 50	\$100
2nd OFFENSE	\$100	\$200
3rd & SUBSEQUENT	\$250	\$500

974 CAR TANK VEHICLE : TR # 46  
54-12B-109 1972 Ford (STR) R61111N10558

OK  
1. Vent cover shall be repaired to prevent spillage of flammable liquid.

OK  
2. Union on dispensing hose shall be repaired to prevent leakage of fuel.

OK  
3. Leak on grease reel shall be repaired


OK to file

By Order of  
FIRE MARSHAL

INSPECTOR Joseph Sapienza 6590

DATE of COMPLIANCE 9/13/84

Inspector Sapienza



CITY OF ROCHESTER

FIRE DEPARTMENT

FIRE SAFETY  
PERMIT RELEASE & INVOICE

FIRE SAFETY DIVISION

Public Safety Building  
Civic Center Plaza  
Rochester, New York 14614  
(716) 428-7037 & 428-7038

LOCATION: 788 RIDGE RD W

11233	PERMIT NUMBER
	DATE
	FEE TOTAL
	DATE RELEASED
8/15/87	EXPIRATION DATE

PERMIT CODE	PERMIT CATEGORY	FEE
5412B04	DUST PRODUCING OPERATION	\$ 30
5412B08	FLAMMABLE LIQUID STORAGE	\$ 15
5412B10A	FLAMMABLE LIQUID STORAGE	\$ 15
5412B10B	ACETYLENE/FLAMMABLE GAS USAGE	\$ 25
5412B18	PRIVATE PLANT	\$ 80
5412B24		\$ 80

RECEIVED  
AUG 19 1985  
C. P. WARD, INC.

MAIL YOUR CHECK OR PRESENT THIS INVOICE WITH FEE PAID IN FULL TO:

NAME  
MAILING ADDRESS

C P WARD INC  
800 W RIDGE RD  
ROCHESTER

NY 14615

TOTAL \$ 210

165.00

CITY TREASURER  
ROOM 100 A, CITY HALL  
ROCHESTER, NEW YORK 14614

PLEASE WRITE PERMIT NUMBERS ON YOUR CHECK



**CITY OF ROCHESTER  
FIRE DEPARTMENT**

**FIRE SAFETY  
PERMIT RELEASE & INVOICE**

**FIRE SAFETY DIVISION**

Public Safety Building  
Civic Center Plaza  
Rochester, New York 14614  
(716) 428-7037 & 428-7038

LOCATION: 788 RIDGE RD W

PERMIT CODE	PERMIT CATEGORY	FEE
5412B08	DUST PRODUCING OPERATION	\$ 30
5412B10A	FLAMMABLE LIQUID STORAGE	\$ 15
5412B10B	FLAMMABLE LIQUID STORAGE	\$ 15
5412B18	ACETYLENE/FLAMMABLE GAS USAGE	\$ 25
5412B24	PRIVATE PLANT	\$ 80
<b>TOTAL</b>		<b>\$ 165</b>

5412B04  
5412B08  
5412B10A  
5412B10B  
5412B18  
5412B24

**RECEIVED**  
AUG 19 1985  
C. P. WARD, INC.

MAIL YOUR CHECK OR PRESENT THIS INVOICE WITH FEE PAID IN FULL TO:


NAME: C. P. WARD, INC.  
MAILING ADDRESS: 800 W RIDGE RD, ROCHESTER, NY 14615

CITY TREASURER  
ROOM 100 A, CITY HALL  
ROCHESTER, NEW YORK 14614

PLEASE WRITE PERMIT NUMBERS ON YOUR CHECK

01233	PERMIT NUMBER
	DATE
	FEE TOTAL
	DATE RELEASED
8/15/87	EXPIRATION DATE

TOTAL \$ 165.00



**CITY OF ROCHESTER  
FIRE DEPARTMENT  
PERMIT**

**FIRE SAFETY DIVISION**  
Public Safety Building  
Civic Center Plaza  
Rochester, New York 14614  
(716) 428-7494

**1650**

For keeping, storing, using, installing, manufacturing, handling, transporting, or otherwise employing flammable, combustible, or explosive materials, or materials, processes or equipment, which if improperly used may produce conditions hazardous to life or property.

JULY 1985

(Date)

**TO WHOM IT MAY CONCERN:**

By virtue of the provisions of the Fire Prevention Code of the City of Rochester, N. Y., C P WARD

(Name of Concern)

No. 788 Street RIDGE ROAD WEST

conducting an PRIVATE PLANT & REPAIR SHOP

(Operation)

having made application in due form, and as the conditions, surroundings, and arrangements are, in my opinion, such that the intent of the Fire Prevention Code can be observed, authority is hereby given and this PERMIT is GRANTED for 5412B-1 TIRE RECAPPING

This PERMIT is issued and accepted on condition that all Fire Prevention Code provisions now adopted, or that may hereafter be adopted, shall be complied with.

THIS PERMIT EXPIRES AUGUST 15, 1986

This permit does not take the place of any license required by law and is not transferable. Any change in the use or occupancy of premises shall require a new permit.

*E. J. Longfellow*  
Fire Marshal  
*[Signature]*  
CITY TREASURER

**THIS PERMIT MUST AT ALL TIMES BE KEPT POSTED ON THE PREMISES MENTIONED ABOVE**

Location 288 W. Ridge Rd CVALLEY SAND AND GRAVEL CO

Construction Cinder Block Stories 1 Length 25 Width 30

Use of Bldg. Offices

Fire Extinguishers: No. and Kind 2 Dry Chemical

Floor Openings Other Than Stairs or Elevators: None

How Protected? \_\_\_\_\_

Heating Apparatus: Type Oil

Location of Floor Drains: None

How Can Access Be Gained to Basement? None


Main Electrical Switch: None

Water Main Shut Off: South west wall

Gas Shut Off: None

Air Conditioning Shut Off: None

Special Conditions: 270 gal Fuel Tank above ground - next to south east wall

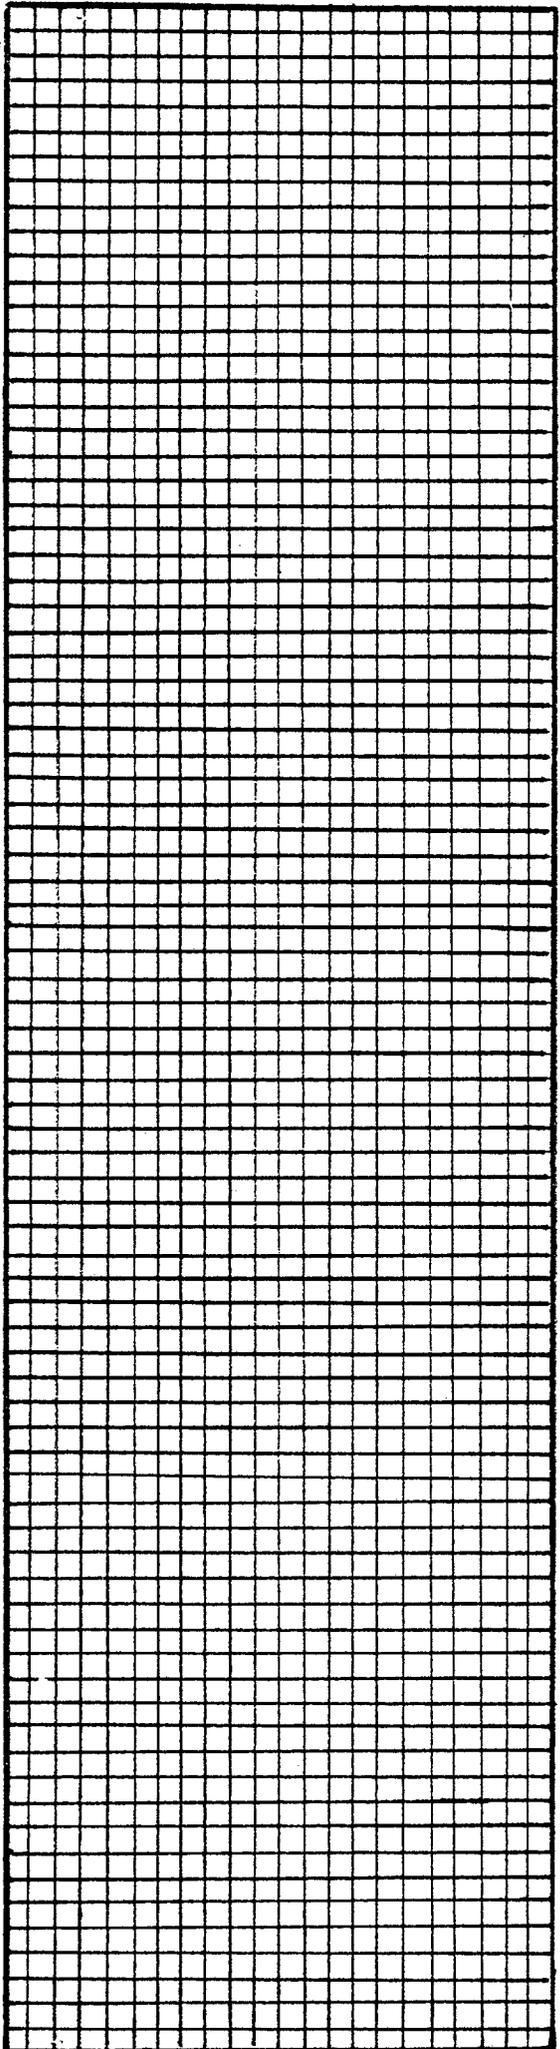



(12)

Fire Safety Division

Location 288 W. Ridge Rd (Valley Sand and Gravel Co)

Construction Wood frame Bldg. Stories 1 Length 55' Width 20'

Use of Bldg. Fire Storage

Fire Extinguishers: No. and Kind 1 Dry Chemical & CO2

Floor Openings Other Than Stairs or Elevators: None

How Protected? \_\_\_\_\_

Heating Apparatus: Type oil

Location of Floor Drains: None

How Can Access Be Gained to Basement? None


Main Electrical Switch: North Wall

Water Main Shut Off: None

Gas Shut Off: None

Air Conditioning Shut Off: None

Special Conditions: 2905 pumps 3000 gal under ground tank next to north east wall of this Bldg.

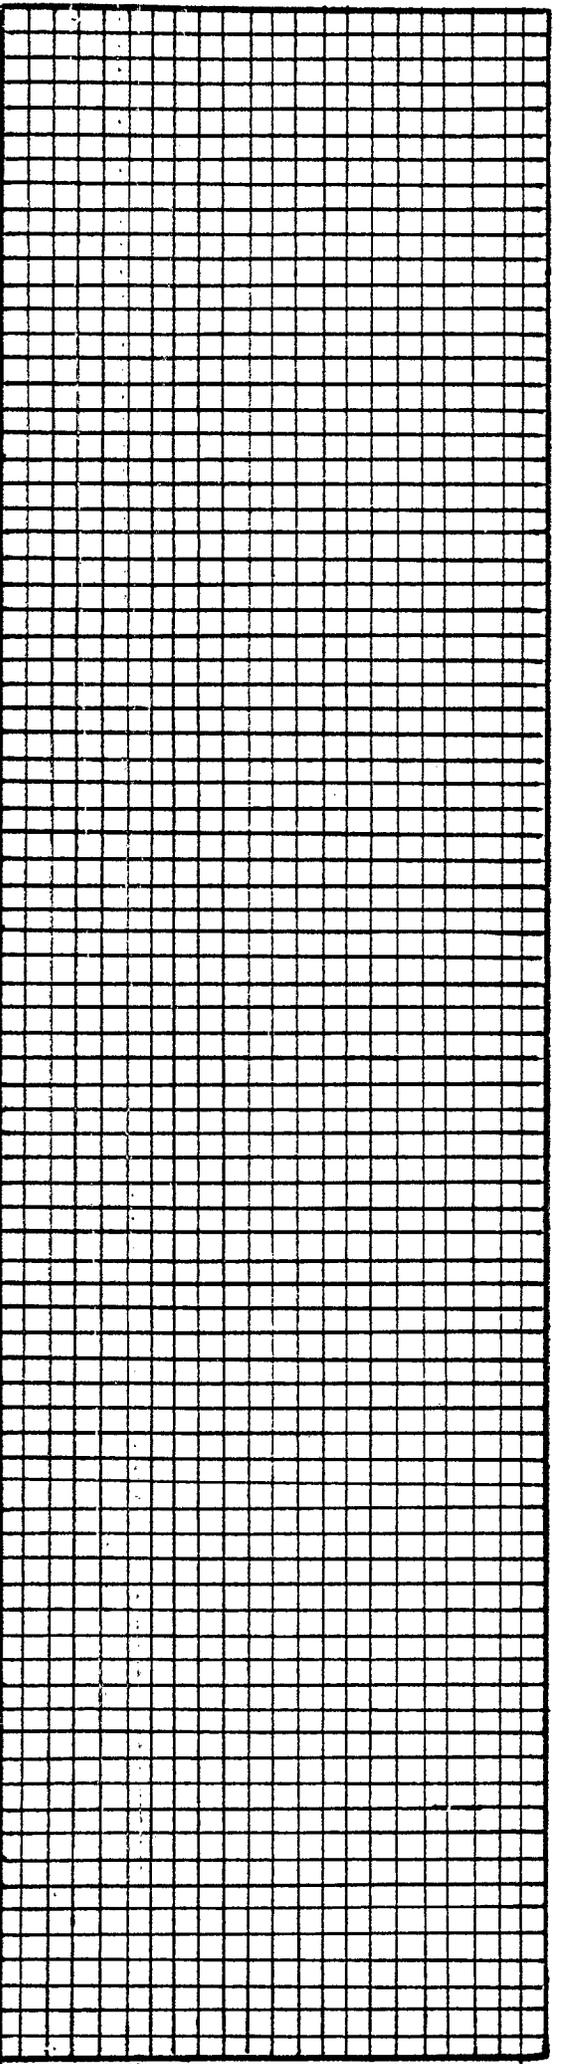



13

Fire Safety Division

Location 288 W. Ridge Rd. Curley Sand and Gravel Co.

Construction Cinder Block Stories 1 Length 55' Width 60'

Use of Bldg. Repair Shop

Fire Extinguishers: No. and Kind 6 Co<sup>2</sup> 8 Dry Chemical

Floor Openings Other Than Stairs or Elevators: None

How Protected? \_\_\_\_\_

Heating Apparatus: Type Oil heat

Location of Floor Drains: Center of garage Area - center east wall of Boiler Room

How Can Access Be Gained to Basement? None

Main Electrical Switch: center wall of garage north wall of Boiler Room

Water Main Shut Off: None

Gas Shut Off: None

Air Conditioning Shut Off: None

Special Conditions: 6000, 3000, 2000 gal fuel oil tanks underground - west side of Bldg.

