




CITY OF ROCHESTER	
PLASTIC WATER SERVICE TRACER WIRE INSTALLATION	
ISSUED	1-13-06 NON-STANDARD
REVISED	2-19-15 DWG. NO. S901-9

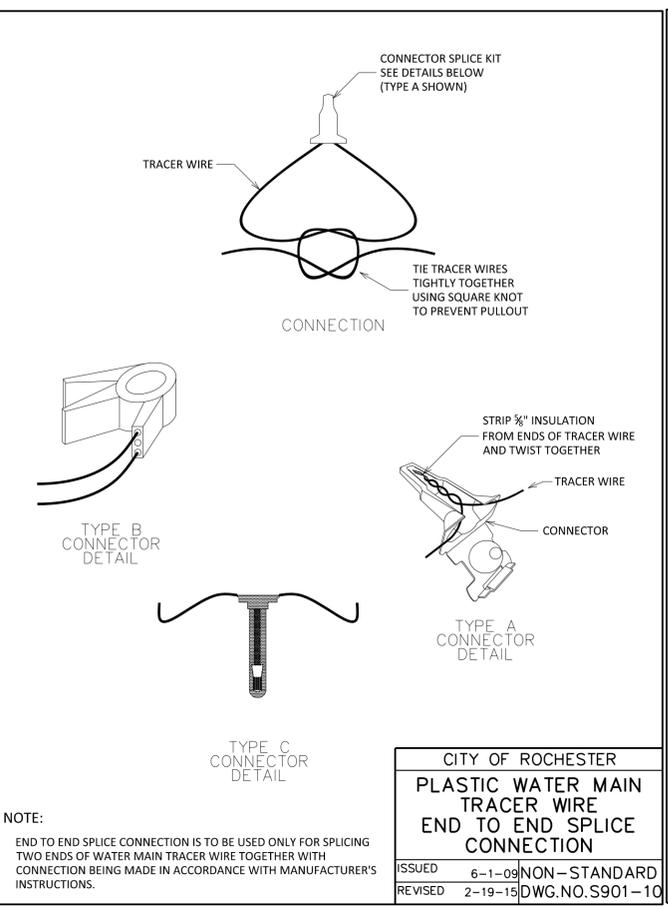


CITY OF ROCHESTER	
PLASTIC WATER MAIN TRACER WIRE END TO END SPLICE CONNECTION	
ISSUED	6-1-09 NON-STANDARD
REVISED	2-19-15 DWG. NO. S901-10

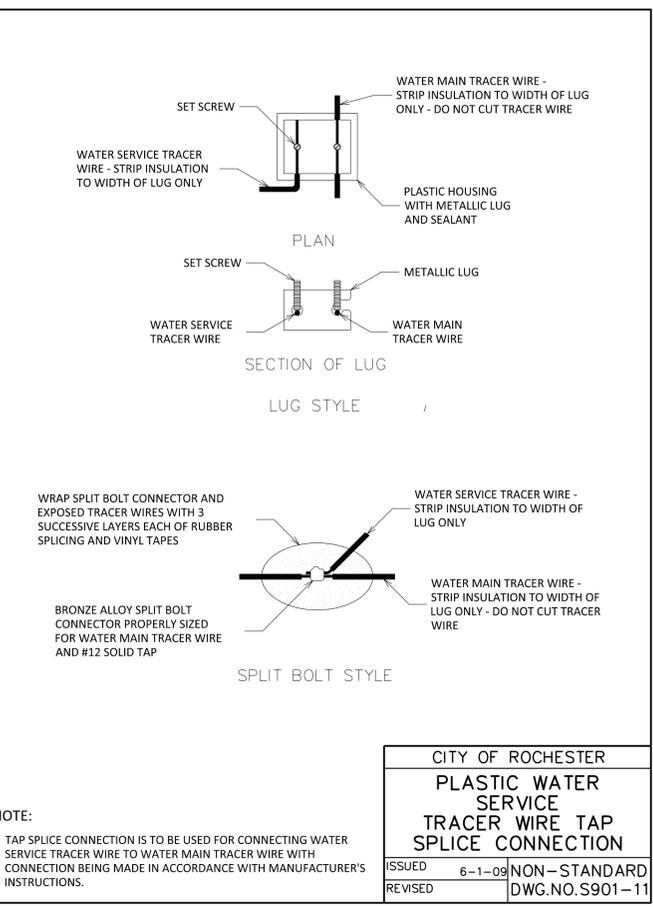

CITY OF ROCHESTER	
PLASTIC WATER SERVICE TRACER WIRE TAP SPLICE CONNECTION	
ISSUED	6-1-09 NON-STANDARD
REVISED	2-19-15 DWG. NO. S901-11

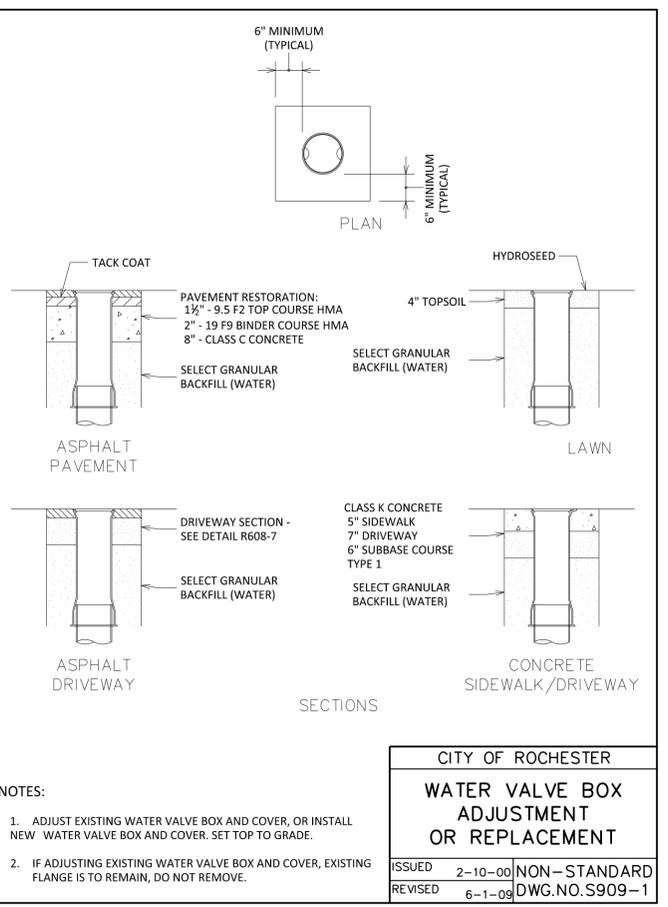

CITY OF ROCHESTER	
WATER VALVE BOX ADJUSTMENT OR REPLACEMENT	
ISSUED	2-10-00 NON-STANDARD
REVISED	6-1-09 DWG. NO. S909-1

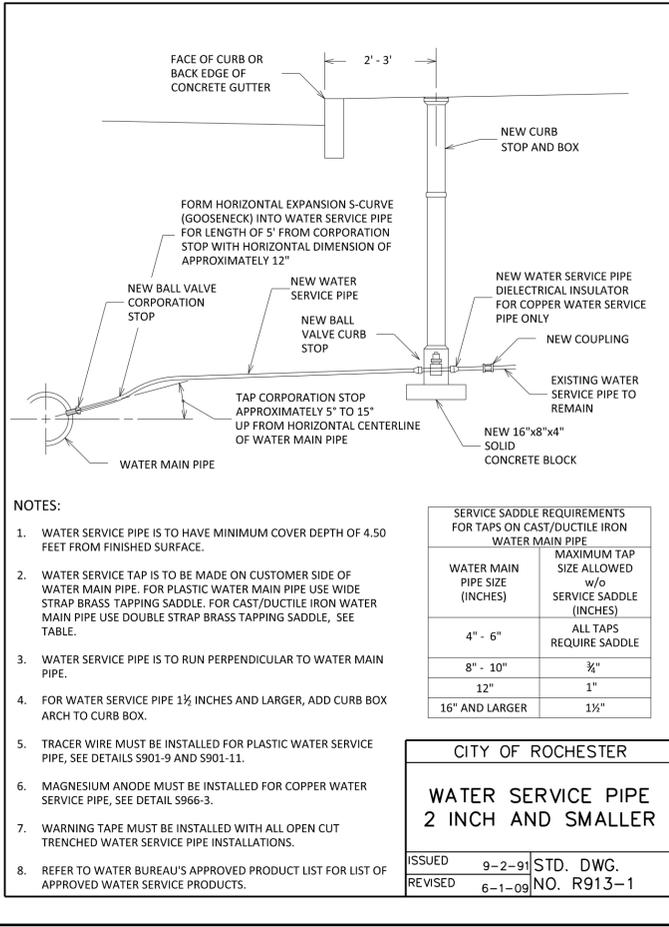

SERVICE SADDLE REQUIREMENTS FOR TAPS ON CAST/DUCTILE IRON WATER MAIN PIPE	
WATER MAIN PIPE SIZE (INCHES)	MAXIMUM TAP SIZE ALLOWED w/o SERVICE SADDLE (INCHES)
4" - 6"	ALL TAPS REQUIRE SADDLE
8" - 10"	3/4"
12"	1"
16" AND LARGER	1 1/2"

CITY OF ROCHESTER	
WATER SERVICE PIPE 2 INCH AND SMALLER	
ISSUED	9-2-91 STD. DWG.
REVISED	6-1-09 NO. R913-1

CITY OF ROCHESTER WATER SERVICE INSTALLATION DATA

PROPERTY ADDRESS: _____

STREET SERVICE TAPPED ON (IF DIFFERENT): _____

DATE OF INSTALLATION: _____ DOMESTIC OR HOLLY SYSTEM?

TAP SIZE: _____ DISTANCE, MAIN TO ROW LINE: _____ SIDE OF ST. TAPPED: _____

CURB STOP/VALVE SIZE: _____ SERVICE LENGTH: _____ SERVICE MATERIAL: _____

CONTRACTOR/PLUMBER: _____

TAP INSTALLED BY: _____ INSPECTOR: _____

CURB OR OPERATING VALVE LOCATION * : _____

TAP OR GUARD VALVE LOCATION (IF DIFFERENT): _____

INSULATOR INSTALLED? _____ IF YES, WHERE: TAP _____ CURB STOP _____

ANODE INSTALLED? _____ IF YES, SIZE: _____ LBS., ATTACHED TO: TAP _____ SERVICE _____ MAIN _____


INSIDE SERVICE MATERIAL & SIZE: _____

* MEASURED FROM ROW OF NEAREST INTERSECTING STREET OR HYDRANT, WHICHEVER IS CLOSER OCT. 2013


NOTES:

- WATER SERVICE CARD WILL BE SUPPLIED BY WATER BUREAU. REQUIRED INFORMATION IS TO BE TYPED OR NEATLY PRINTED ON WATER SERVICE CARD.
- WATER SERVICE CARD FOR WATER SERVICE THAT IS ABANDONED AT TAP IS TO BE MARKED "ABANDONED AT TAP" ACROSS FACE OF WATER SERVICE CARD WITH CONTRACTOR'S NAME AND DATE ABANDONED BEING NOTED.
- MEASUREMENT FOR LOCATION OF CURB STOP IS TO BE TAKEN FROM RIGHT-OF-WAY EXTENSION OF NEAREST INTERSECTING STREET AS MEASURED PARALLEL TO STREET ON WHICH WATER SERVICE IS INSTALLED, OR FROM NEAREST HYDRANT LOCATED OFF OF SAME WATER MAIN, WHICHEVER IS CLOSER (SEE NOTE 4 FOR EXCEPTION). WHENEVER POSSIBLE, MEASUREMENTS SHOULD BE LESS THAN 300 FEET.
- IF NEAREST INTERSECTING STREET RIGHT-OF-WAY EXTENSION IS NOT PERPENDICULAR TO THE STREET RIGHT-OF-WAY ON WHICH THE CURB STOP IS LOCATED, THE CURB STOP MEASUREMENT SHOULD BE TAKEN FROM THE NEAREST HYDRANT ATTACHED TO THE WATER MAIN WHICH THE WATER SERVICE IS CONNECTED TO. IF SUCH A HYDRANT IS NOT AVAILABLE, THEN ANOTHER PERMANENT FEATURE, PRE-APPROVED BY THE WATER BUREAU, SHALL BE USED FOR THE CURB STOP MEASUREMENT.
- MEASUREMENTS ARE TO BE ENTERED IN TENTHS OF FEET. DO NOT USE INCHES. ROUNDING TO THE NEAREST 0.5 FEET IS ACCEPTABLE.
- IF SERVICE IS INSTALLED WITH HORIZONTAL BEND, DRAW A SKETCH ON THE BACK OF THE CARD SHOWING THE LOCATIONS OF THE MAIN, CORPORATION, SERVICE AND CURB STOP. THE DISTANCE BETWEEN THE BEND AND CURB STOP AND OFFSET DIMENSIONS BETWEEN THE BEND AND THE CORPORATION AND CURB STOP SHOULD BE SHOWN IN THE SKETCH.

CITY OF ROCHESTER	
WATER SERVICE CARD	
ISSUED	9-2-91 STD. DWG.
REVISED	10-23-13 NO. R913-3

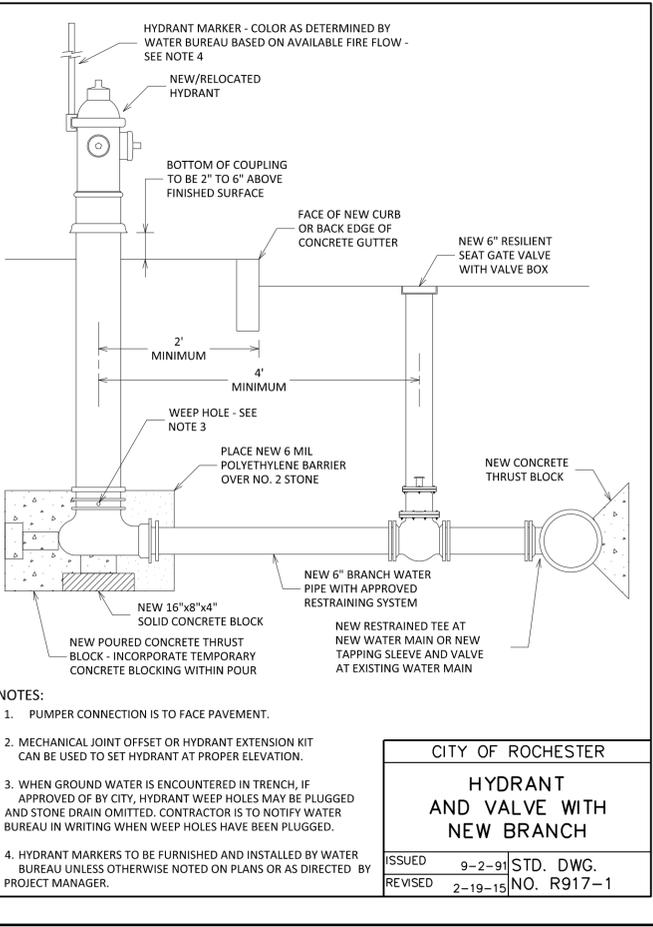

CITY OF ROCHESTER	
HYDRANT AND VALVE WITH NEW BRANCH	
ISSUED	9-2-91 STD. DWG.
REVISED	2-19-15 NO. R917-1

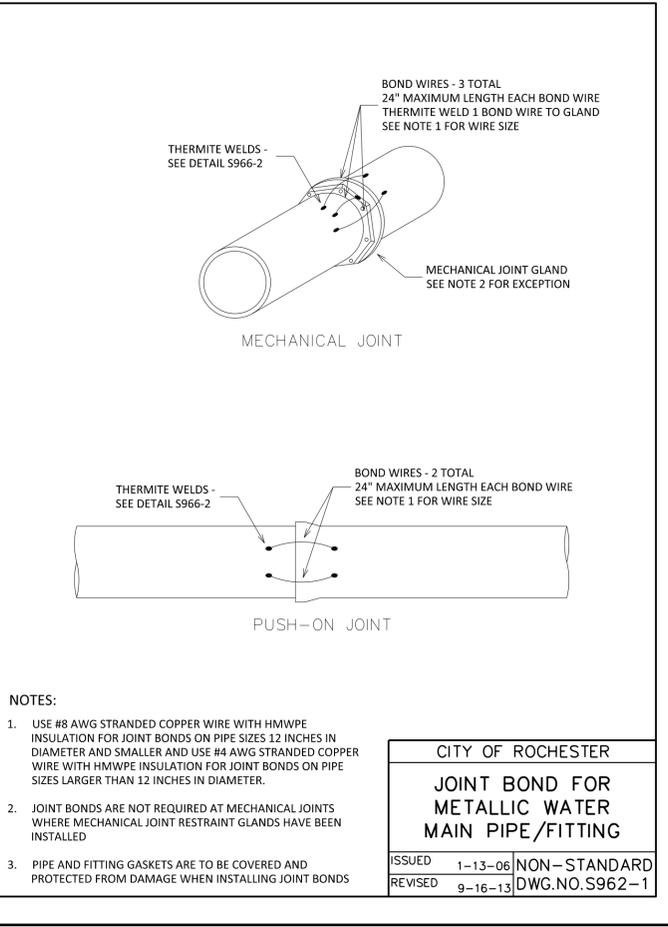

CITY OF ROCHESTER	
JOINT BOND FOR METALLIC WATER MAIN PIPE/FITTING	
ISSUED	1-13-06 NON-STANDARD
REVISED	9-16-13 DWG. NO. S962-1

Department of Environmental Services
Architecture and Engineering Services
City of Rochester, New York

PROJECT TITLE: STREET IMPROVEMENT PROGRAM HINCHER GROUP

MANAGING ENGINEER: ALBERT J. GIGLIO, P.E.
CITY ENGINEER: JAMES R. MONTOSH, P.E.

ISSUED	CHECKED	DRAWN	DESIGN	SCALE	PROJECT NUMBER	NO.	REVISION	DATE
JUNE 1, 2015	LYR	RKS	LYR	NONE	12/109			

DRAWING NO. 40 OF 50